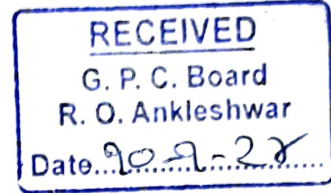



ENVIRO TECHNOLOGY LIMITED
Ref: ETL/ANK/01/2024/827
Date: 10th January, 2024

To,
 Ministry of Environment, Forest & Climate Change,
 Integrated Regional Office,
 Room no. 407, Aranya Bhawan,
 Near CH-3 Circle, Sector 10A,
 Gandhinagar- 382010



Subject: Half yearly EC Compliance Status of Environmental clearance for expansion of M/s Enviro Technology Limited Common Effluent Treatment Plant for the period April-2023 to September-2023.

Ref.:

1. Environmental Clearance No. 10-2/2008-IA-III dated 23rd July 2009.
2. Environmental Clearance No. 10-2/2008-IA-III dated 3rd July 2017.
3. Environmental Clearance No. 10-82/2018-IA-III dated 16th December 2019

Respected Sir,

ETL is operating a CETP consisting of primary, secondary, and tertiary treatment located at plot No 2413/14 GIDC estate, Ankleshwar-393002, Dist.Bharuch,Gujarat.

We have two ECs referred under 1&3 and an EC validity extension referred under 2. We would like to draw your kind attention on the following:

1. EC referred under 1&2 i.e., EC dated 2009 & its validity extension dated 2017; we have not implemented any expansion as per this EC due to moratorium imposed on the critically polluted area which included Ankleshwar, and the validity of this EC is over on 22.07.2019. Non-implementation of this project is also mentioned in our EC dated 16.12.2019. Therefore, as the validity of this over, compliance report of this EC is not submitted.
2. EC dated 16.12.2019, referred under 3 for expansion (from 1.8 MLD to 3.5 MLD effluent) with modification is also not yet implemented. We have obtained a CTE from GPCB on 22.04.20 but due to Pandemic Covid-19, the project was delayed. Currently construction work for the said project is completed and plant is ready for commissioning.

We have not implemented EC 10-82/2018-IA-III dated 2019, but with this we are submitting its current compliance status along with all the required documents.

Kindly note that, ETL is currently operating on effluent inlet of 2.2 MLD as per its CCA amendment no.113210 dated 07.08.21.

CIN NO. : U72200GJ1994PLC023786

Works Office : 2413/2414 & 2211, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)

Phone : (02646) 223569, 252768, 250707

Email : dalwadibd@beil.co.in, darjam@beil.co.in

Reg. Office : 9701-16, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)



ETL inlet and discharge quantities for the said period are as below which are within limits as per CCA dated 07.08.21:

Period	Average Inlet effluent (MLD)	Average Sewage (MLD)	Average Discharge Quantity along with sewage (MLD)
April-2023 to September-2023	1.483	0.98	2.37
Capacity as per CCA-113210 dated 07.08.21	2.2	1.1	3.5

We would like to bring to your kind attention that the treated effluent is discharged to FETP operated by NCT for further treatment and disposal to deep sea.

Thanking you,
Yours faithfully,
For Enviro Technology Limited


A. M. Darji
General Manager

C.C: (1) Gujarat Pollution Control Board
Ankleshwar

CIN NO. : U72200GJ1994PLC023786
Works Office : 2413/2414 & 2211, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)
Phone : (02646) 223569, 252768, 250707
Email : dalwadibd@beil.co.in, darjiam@beil.co.in
Reg. Office : 9701-16, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)

Compliance Status for the period of April'23 to September'23, of Environment clearance to M/s Enviro Technology Ltd for expansion of Common Effluent Treatment Plant at plot no 2413/14, Notified G.I.D.C. Estate, Ankleshwar. In category B- 7(h) of schedule with EIA notification, 2006.

Environmental Clearance No. 10-2/2008-IA.III dated 23rd July, 2009.

1. This has reference to your letter No ETL/ANK/2007 dated 14.12.2007 and subsequent letter date 19.11.2008 on the subject mentioned above, seeking prior environment Impact Assessment Clearance for the above project under EIA notification 2006. The proposal has been appraised as per prescribed procedure in the light of provision under the EIA notification, 2006 on the basis of the mandatory documents enclosed with the application viz., the Questionnaire, EIA, EMP and the additional clarification furnished in response to the observation of the Expert Appraisal Committee constituted by the competent authority in its meeting held on 23rd – 25th January 2008. The information was provided by the Gujarat Pollution Control Board vide their letter No. BRCH/CCA/128/6/2009 dated 4.4.2009.

: Noted

2. It is inter-alia, noted that the project involves expansion of existing common effluent treatment plant at plot No 2413/14, Notified GIDC Estate, Ankleshwar there is an existing CETP with 1.8 MLD capacity to cater small scale industries and proposed to enhance the capacity to 3.5 MLD. The effluent from the member unit is transported by rubber-lined tanker to the CETP. The effluent after checking the quality is unloaded in equalization tanks. The equalized effluent is neutralized with the lime solution and pH is increased to 9-10 to precipitate the heavy metal present in the effluent. After this, the effluent is sent to the primary clarifier, where solids settle in the bottom of the clarifier. The supernatant from the clarifier goes to the secondary treatment. The sludge from the bottom of the primary clarifier is sent to the Rotary vacuum Drum Filters/Decanter for the removal of moisture. The sludge cake from the Filters/decanter is sold to the cement industries or is sent to the landfill site. After the tertiary treatment, the effluent is sent to the FETP for the further treatment and disposed into sea. Existing consumption pattern of raw water is 600 m³/day and proposed consumption pattern of raw water is 1445 m³/day. Total power requirement for the project will be 1100 KVA, which will be met from GEB and DG set (for emergency use only). The total cost of the project is Rs.9.0 crore.

: Noted

3. The project falls under category 'B'-7(h) of EIA Notification, 2006, but as the project is located at Ankleshwar which is notified as critically Polluted area by Central Pollution Control Board. Because of above, General Condition (GC) shall apply and the project is treated as category A and appraised at central level.

: Noted

4. The Expert Appraisal Committee, after due consideration of the relevant document submitted by the project proponent and additional clarifications furnished in response to its observation, have recommended for grant of Environment Clearance. Accordingly, the Ministry hereby accord necessary Clearance as per the provision of Environment Impact Assessment notification, 2006, subject to strict compliance of the terms and conditions as follows:

1. SPECIFIC CONDITION:

Sr. No	Description	Status																																																																																																																																																		
I.	The effluent shall be discharged in accordance with the standards laid down by Gujarat pollution control board.	<p>Complied.</p> <p>Our treated effluent is discharged through dedicated line for further treatment of FETP, Namely, NCT (Narmada Clean Tech) before deep sea discharge.</p> <table border="1" data-bbox="635 573 1458 1043"> <thead> <tr> <th colspan="8">Average of Final Discharge Quality for 2.2 MLD</th> </tr> <tr> <th>Month</th> <th>Apr.-23</th> <th>May-23</th> <th>June-23</th> <th>July-23</th> <th>Aug.-23</th> <th>Sep.-23</th> <th>GPCB Permissible Limits</th> </tr> </thead> <tbody> <tr> <td>pH</td> <td>7.76</td> <td>7.54</td> <td>7.66</td> <td>7.56</td> <td>7.53</td> <td>7.48</td> <td>6.5 to 8.5</td> </tr> <tr> <td>COD</td> <td>884</td> <td>865.07</td> <td>842</td> <td>661</td> <td>804.31</td> <td>835.07</td> <td>1000 mg/L</td> </tr> <tr> <td>BOD</td> <td>6.90</td> <td>4.88</td> <td>6.33</td> <td>5</td> <td>7.38</td> <td>8.27</td> <td>200 mg/L</td> </tr> <tr> <td>TSS</td> <td>45.28</td> <td>44.90</td> <td>44.60</td> <td>47.81</td> <td>47.71</td> <td>59.33</td> <td>150 mg/L</td> </tr> <tr> <td>NH4-N</td> <td>64.40</td> <td>36.90</td> <td>41.10</td> <td>48.26</td> <td>43.06</td> <td>37.53</td> <td>50 mg/L</td> </tr> </tbody> </table> <p>The monthly NCT qualitative and quantitative data of our effluent discharged is as below.</p> <table border="1" data-bbox="608 1211 1477 2027"> <thead> <tr> <th>Date</th> <th>pH</th> <th>COD</th> <th>NH4-N</th> <th>TSS</th> </tr> </thead> <tbody> <tr> <td>NCT Norms</td> <td>6.5-8.5</td> <td>1000</td> <td>75</td> <td>150</td> </tr> <tr> <td>07.04.2023</td> <td>8</td> <td>551</td> <td>42</td> <td>41</td> </tr> <tr> <td>12.04.2023</td> <td>7.89</td> <td>618</td> <td>46</td> <td>68</td> </tr> <tr> <td>17.04.2023</td> <td>7.52</td> <td>736</td> <td>38</td> <td>54</td> </tr> <tr> <td>21.04.2023</td> <td>7.37</td> <td>610</td> <td>24</td> <td>62</td> </tr> <tr> <td>24.04.2023</td> <td>7.56</td> <td>677</td> <td>44</td> <td>41</td> </tr> <tr> <td>30.04.2023</td> <td>7.24</td> <td>715</td> <td>46</td> <td>49</td> </tr> <tr> <td>03.05.2023</td> <td>7.27</td> <td>709</td> <td>31</td> <td>54</td> </tr> <tr> <td>09.05.2023</td> <td>7.24</td> <td>645</td> <td>30</td> <td>46</td> </tr> <tr> <td>11.05.2023</td> <td>7.36</td> <td>674</td> <td>28</td> <td>54</td> </tr> <tr> <td>31.05.2023</td> <td>7.37</td> <td>758</td> <td>27</td> <td>62</td> </tr> <tr> <td>04.06.2023</td> <td>7.27</td> <td>763</td> <td>36</td> <td>33</td> </tr> <tr> <td>08.06.2023</td> <td>7.19</td> <td>864</td> <td>33</td> <td>45</td> </tr> <tr> <td>12.06.2023</td> <td>7.18</td> <td>790</td> <td>30</td> <td>43</td> </tr> <tr> <td>15.06.2023</td> <td>7.28</td> <td>792</td> <td>30</td> <td>52</td> </tr> <tr> <td>23.06.2023</td> <td>7.05</td> <td>769</td> <td>46</td> <td>56</td> </tr> <tr> <td>25.06.2023</td> <td>7.19</td> <td>755</td> <td>46</td> <td>51</td> </tr> </tbody> </table>	Average of Final Discharge Quality for 2.2 MLD								Month	Apr.-23	May-23	June-23	July-23	Aug.-23	Sep.-23	GPCB Permissible Limits	pH	7.76	7.54	7.66	7.56	7.53	7.48	6.5 to 8.5	COD	884	865.07	842	661	804.31	835.07	1000 mg/L	BOD	6.90	4.88	6.33	5	7.38	8.27	200 mg/L	TSS	45.28	44.90	44.60	47.81	47.71	59.33	150 mg/L	NH4-N	64.40	36.90	41.10	48.26	43.06	37.53	50 mg/L	Date	pH	COD	NH4-N	TSS	NCT Norms	6.5-8.5	1000	75	150	07.04.2023	8	551	42	41	12.04.2023	7.89	618	46	68	17.04.2023	7.52	736	38	54	21.04.2023	7.37	610	24	62	24.04.2023	7.56	677	44	41	30.04.2023	7.24	715	46	49	03.05.2023	7.27	709	31	54	09.05.2023	7.24	645	30	46	11.05.2023	7.36	674	28	54	31.05.2023	7.37	758	27	62	04.06.2023	7.27	763	36	33	08.06.2023	7.19	864	33	45	12.06.2023	7.18	790	30	43	15.06.2023	7.28	792	30	52	23.06.2023	7.05	769	46	56	25.06.2023	7.19	755	46	51
Average of Final Discharge Quality for 2.2 MLD																																																																																																																																																				
Month	Apr.-23	May-23	June-23	July-23	Aug.-23	Sep.-23	GPCB Permissible Limits																																																																																																																																													
pH	7.76	7.54	7.66	7.56	7.53	7.48	6.5 to 8.5																																																																																																																																													
COD	884	865.07	842	661	804.31	835.07	1000 mg/L																																																																																																																																													
BOD	6.90	4.88	6.33	5	7.38	8.27	200 mg/L																																																																																																																																													
TSS	45.28	44.90	44.60	47.81	47.71	59.33	150 mg/L																																																																																																																																													
NH4-N	64.40	36.90	41.10	48.26	43.06	37.53	50 mg/L																																																																																																																																													
Date	pH	COD	NH4-N	TSS																																																																																																																																																
NCT Norms	6.5-8.5	1000	75	150																																																																																																																																																
07.04.2023	8	551	42	41																																																																																																																																																
12.04.2023	7.89	618	46	68																																																																																																																																																
17.04.2023	7.52	736	38	54																																																																																																																																																
21.04.2023	7.37	610	24	62																																																																																																																																																
24.04.2023	7.56	677	44	41																																																																																																																																																
30.04.2023	7.24	715	46	49																																																																																																																																																
03.05.2023	7.27	709	31	54																																																																																																																																																
09.05.2023	7.24	645	30	46																																																																																																																																																
11.05.2023	7.36	674	28	54																																																																																																																																																
31.05.2023	7.37	758	27	62																																																																																																																																																
04.06.2023	7.27	763	36	33																																																																																																																																																
08.06.2023	7.19	864	33	45																																																																																																																																																
12.06.2023	7.18	790	30	43																																																																																																																																																
15.06.2023	7.28	792	30	52																																																																																																																																																
23.06.2023	7.05	769	46	56																																																																																																																																																
25.06.2023	7.19	755	46	51																																																																																																																																																

28.06.2023	7.25	796	42	45
07.07.2023	7.19	610	49	71
11.07.2023	7.42	682	55	48
20.07.2023	7.44	624	40	52
22.07.2023	7.25	608	41	30
06.08.2023	7.03	800	41	58
12.08.2023	7	774	42	46
22.08.2023	6.94	712	26	38
25.08.2023	7.06	766	35	39
04.09.2023	7.06	784	34	42
11.09.2023	7.08	776	39	39
15.09.2023	7.02	738	40	63
22.09.2023	7.03	771	33	19

Test Reports of NCT attached as Annexure – 1 (A)

II.	The ammonia levels in the effluent shall be monitored.	<p>Complied.</p> <p>We are regularly monitoring ammonia level of effluent in ETL laboratory. Our laboratory is NABL accredited.</p> <p>Also, the same are monitored by our GPCB Recognized Schedule – I Environment Auditors. The average lab analysis results and Environment Audit results of Ammonical Nitrogen for the period of April’23 to Sep’23 is as below:</p> <table border="1" data-bbox="608 544 1485 920"> <thead> <tr> <th colspan="4">Analysis results of Ammonical Nitrogen (mg/L)</th> </tr> <tr> <th>Month</th> <th>Avg. Internal Results</th> <th>Environment Audit Results</th> <th>GPCB Permissible Limit (mg/L)</th> </tr> </thead> <tbody> <tr> <td>April’23</td> <td>64.40</td> <td></td> <td rowspan="6">50</td> </tr> <tr> <td>May’23</td> <td>36.90</td> <td></td> </tr> <tr> <td>June’23</td> <td>41.10</td> <td></td> </tr> <tr> <td>July’23</td> <td>48.26</td> <td></td> </tr> <tr> <td>August’23</td> <td>43.06</td> <td>50</td> </tr> <tr> <td>September’23</td> <td>37.53</td> <td></td> </tr> </tbody> </table> <p>NABL certificate of ETL laboratory attached as Annexure-1(B).</p> <p>Test Reports of Environment Audit attached as Annexure –1(C).</p>	Analysis results of Ammonical Nitrogen (mg/L)				Month	Avg. Internal Results	Environment Audit Results	GPCB Permissible Limit (mg/L)	April’23	64.40		50	May’23	36.90		June’23	41.10		July’23	48.26		August’23	43.06	50	September’23	37.53	
Analysis results of Ammonical Nitrogen (mg/L)																													
Month	Avg. Internal Results	Environment Audit Results	GPCB Permissible Limit (mg/L)																										
April’23	64.40		50																										
May’23	36.90																												
June’23	41.10																												
July’23	48.26																												
August’23	43.06	50																											
September’23	37.53																												
III.	No ground water shall be tapped for the project.	<p>Not applicable</p> <p>No ground water is utilized at site, water supply is from GIDC Notified Area Authority.</p>																											
IV.	A land area of 10 acres shall be earmarked for the development for green belt.	<p>Noted for compliance.</p> <p>Currently 18% is the green belt area.</p> <p>Layout Attached as Annexure – 1(D)</p>																											

V.	The project proponent shall ensure that chemicals/solvents such as Methyl chloride and other toxic solvents are not allowed to enter CETP.	<p>Complied.</p> <p>Average CETP inlet data is as under:</p> <table border="1" data-bbox="635 322 1457 792"> <thead> <tr> <th colspan="8">Average of Final Discharge Quality for 2.2 MLD</th> </tr> <tr> <th>Month</th> <th>Apr.-23</th> <th>May-23</th> <th>June-23</th> <th>July-23</th> <th>Aug.-23</th> <th>Sep.-23</th> <th>GPCB Permissible Limits</th> </tr> </thead> <tbody> <tr> <td>pH</td> <td>7.76</td> <td>7.54</td> <td>7.66</td> <td>7.56</td> <td>7.53</td> <td>7.48</td> <td>6.5 to 8.5</td> </tr> <tr> <td>COD</td> <td>884</td> <td>865.07</td> <td>842</td> <td>661</td> <td>804.31</td> <td>835.07</td> <td>1000 mg/L</td> </tr> <tr> <td>BOD</td> <td>6.90</td> <td>4.88</td> <td>6.33</td> <td>5</td> <td>7.38</td> <td>8.27</td> <td>200 mg/L</td> </tr> <tr> <td>TSS</td> <td>45.28</td> <td>44.90</td> <td>44.60</td> <td>47.81</td> <td>47.71</td> <td>59.33</td> <td>150 mg/L</td> </tr> <tr> <td>NH4-N</td> <td>64.40</td> <td>36.90</td> <td>41.10</td> <td>48.26</td> <td>43.06</td> <td>37.53</td> <td>50 mg/L</td> </tr> </tbody> </table> <p>This is a CETP for small scale industries and the effluent is conveyed through dedicated rubber lined tankers from each industry, each tanker is tested as per the inlet parameters given by GPCB, therefore there are no chances of methyl chloride or other toxic solvents entering CETP.</p>	Average of Final Discharge Quality for 2.2 MLD								Month	Apr.-23	May-23	June-23	July-23	Aug.-23	Sep.-23	GPCB Permissible Limits	pH	7.76	7.54	7.66	7.56	7.53	7.48	6.5 to 8.5	COD	884	865.07	842	661	804.31	835.07	1000 mg/L	BOD	6.90	4.88	6.33	5	7.38	8.27	200 mg/L	TSS	45.28	44.90	44.60	47.81	47.71	59.33	150 mg/L	NH4-N	64.40	36.90	41.10	48.26	43.06	37.53	50 mg/L																													
Average of Final Discharge Quality for 2.2 MLD																																																																																							
Month	Apr.-23	May-23	June-23	July-23	Aug.-23	Sep.-23	GPCB Permissible Limits																																																																																
pH	7.76	7.54	7.66	7.56	7.53	7.48	6.5 to 8.5																																																																																
COD	884	865.07	842	661	804.31	835.07	1000 mg/L																																																																																
BOD	6.90	4.88	6.33	5	7.38	8.27	200 mg/L																																																																																
TSS	45.28	44.90	44.60	47.81	47.71	59.33	150 mg/L																																																																																
NH4-N	64.40	36.90	41.10	48.26	43.06	37.53	50 mg/L																																																																																
VI.	There shall be no disposal of effluents into the water bodies or anywhere outside the project premises.	<p>Complied.</p> <p>We are disposed our treated effluent to NCT-FETP through pipeline for further treatment & disposal to deep sea.</p> <p>Treated effluent characteristics of FETP inlet norms as under:</p> <table border="1" data-bbox="608 1274 1474 2045"> <thead> <tr> <th>Date</th> <th>pH</th> <th>COD</th> <th>NH4-N</th> <th>TSS</th> </tr> </thead> <tbody> <tr> <td>NCT Norms</td> <td>6.5-8.5</td> <td>1000</td> <td>75</td> <td>150</td> </tr> <tr> <td>07.04.2023</td> <td>8</td> <td>551</td> <td>42</td> <td>41</td> </tr> <tr> <td>12.04.2023</td> <td>7.89</td> <td>618</td> <td>46</td> <td>68</td> </tr> <tr> <td>17.04.2023</td> <td>7.52</td> <td>736</td> <td>38</td> <td>54</td> </tr> <tr> <td>21.04.2023</td> <td>7.37</td> <td>610</td> <td>24</td> <td>62</td> </tr> <tr> <td>24.04.2023</td> <td>7.56</td> <td>677</td> <td>44</td> <td>41</td> </tr> <tr> <td>30.04.2023</td> <td>7.24</td> <td>715</td> <td>46</td> <td>49</td> </tr> <tr> <td>03.05.2023</td> <td>7.27</td> <td>709</td> <td>31</td> <td>54</td> </tr> <tr> <td>09.05.2023</td> <td>7.24</td> <td>645</td> <td>30</td> <td>46</td> </tr> <tr> <td>11.05.2023</td> <td>7.36</td> <td>674</td> <td>28</td> <td>54</td> </tr> <tr> <td>31.05.2023</td> <td>7.37</td> <td>758</td> <td>27</td> <td>62</td> </tr> <tr> <td>04.06.2023</td> <td>7.27</td> <td>763</td> <td>36</td> <td>33</td> </tr> <tr> <td>08.06.2023</td> <td>7.19</td> <td>864</td> <td>33</td> <td>45</td> </tr> <tr> <td>12.06.2023</td> <td>7.18</td> <td>790</td> <td>30</td> <td>43</td> </tr> <tr> <td>15.06.2023</td> <td>7.28</td> <td>792</td> <td>30</td> <td>52</td> </tr> <tr> <td>23.06.2023</td> <td>7.05</td> <td>769</td> <td>46</td> <td>56</td> </tr> </tbody> </table>	Date	pH	COD	NH4-N	TSS	NCT Norms	6.5-8.5	1000	75	150	07.04.2023	8	551	42	41	12.04.2023	7.89	618	46	68	17.04.2023	7.52	736	38	54	21.04.2023	7.37	610	24	62	24.04.2023	7.56	677	44	41	30.04.2023	7.24	715	46	49	03.05.2023	7.27	709	31	54	09.05.2023	7.24	645	30	46	11.05.2023	7.36	674	28	54	31.05.2023	7.37	758	27	62	04.06.2023	7.27	763	36	33	08.06.2023	7.19	864	33	45	12.06.2023	7.18	790	30	43	15.06.2023	7.28	792	30	52	23.06.2023	7.05	769	46	56
Date	pH	COD	NH4-N	TSS																																																																																			
NCT Norms	6.5-8.5	1000	75	150																																																																																			
07.04.2023	8	551	42	41																																																																																			
12.04.2023	7.89	618	46	68																																																																																			
17.04.2023	7.52	736	38	54																																																																																			
21.04.2023	7.37	610	24	62																																																																																			
24.04.2023	7.56	677	44	41																																																																																			
30.04.2023	7.24	715	46	49																																																																																			
03.05.2023	7.27	709	31	54																																																																																			
09.05.2023	7.24	645	30	46																																																																																			
11.05.2023	7.36	674	28	54																																																																																			
31.05.2023	7.37	758	27	62																																																																																			
04.06.2023	7.27	763	36	33																																																																																			
08.06.2023	7.19	864	33	45																																																																																			
12.06.2023	7.18	790	30	43																																																																																			
15.06.2023	7.28	792	30	52																																																																																			
23.06.2023	7.05	769	46	56																																																																																			

		<table border="1"> <tbody> <tr><td>25.06.2023</td><td>7.19</td><td>755</td><td>46</td><td>51</td></tr> <tr><td>28.06.2023</td><td>7.25</td><td>796</td><td>42</td><td>45</td></tr> <tr><td>07.07.2023</td><td>7.19</td><td>610</td><td>49</td><td>71</td></tr> <tr><td>11.07.2023</td><td>7.42</td><td>682</td><td>55</td><td>48</td></tr> <tr><td>20.07.2023</td><td>7.44</td><td>624</td><td>40</td><td>52</td></tr> <tr><td>22.07.2023</td><td>7.25</td><td>608</td><td>41</td><td>30</td></tr> <tr><td>06.08.2023</td><td>7.03</td><td>800</td><td>41</td><td>58</td></tr> <tr><td>12.08.2023</td><td>7</td><td>774</td><td>42</td><td>46</td></tr> <tr><td>22.08.2023</td><td>6.94</td><td>712</td><td>26</td><td>38</td></tr> <tr><td>25.08.2023</td><td>7.06</td><td>766</td><td>35</td><td>39</td></tr> <tr><td>04.09.2023</td><td>7.06</td><td>784</td><td>34</td><td>42</td></tr> <tr><td>11.09.2023</td><td>7.08</td><td>776</td><td>39</td><td>39</td></tr> <tr><td>15.09.2023</td><td>7.02</td><td>738</td><td>40</td><td>63</td></tr> <tr><td>22.09.2023</td><td>7.03</td><td>771</td><td>33</td><td>19</td></tr> </tbody> </table> <p>NCT report are attached as an Annexure – 1(A).</p>	25.06.2023	7.19	755	46	51	28.06.2023	7.25	796	42	45	07.07.2023	7.19	610	49	71	11.07.2023	7.42	682	55	48	20.07.2023	7.44	624	40	52	22.07.2023	7.25	608	41	30	06.08.2023	7.03	800	41	58	12.08.2023	7	774	42	46	22.08.2023	6.94	712	26	38	25.08.2023	7.06	766	35	39	04.09.2023	7.06	784	34	42	11.09.2023	7.08	776	39	39	15.09.2023	7.02	738	40	63	22.09.2023	7.03	771	33	19
25.06.2023	7.19	755	46	51																																																																				
28.06.2023	7.25	796	42	45																																																																				
07.07.2023	7.19	610	49	71																																																																				
11.07.2023	7.42	682	55	48																																																																				
20.07.2023	7.44	624	40	52																																																																				
22.07.2023	7.25	608	41	30																																																																				
06.08.2023	7.03	800	41	58																																																																				
12.08.2023	7	774	42	46																																																																				
22.08.2023	6.94	712	26	38																																																																				
25.08.2023	7.06	766	35	39																																																																				
04.09.2023	7.06	784	34	42																																																																				
11.09.2023	7.08	776	39	39																																																																				
15.09.2023	7.02	738	40	63																																																																				
22.09.2023	7.03	771	33	19																																																																				
VII.	In the event of the CETPs not functioning as proposed/breakdown of the CETPs, the units shall closedown immediately and stop discharging the effluent.	<p>Noted for compliance.</p> <p>During breakdown of the FETP, we are not discharging the effluent. We store the effluent in existing guard pond. The capacity of our guard pond is 200-250 m³/month.</p> <p>There was no break-down during the compliance period. Further, we have a preventive maintenance plan to avoid any breakdowns leading to close.</p>																																																																						
VIII.	The units and the CETP shall maintain daily logbook of the quantity and quality of discharge from units, quantity of inflow into the CETP, details of the treatment at each stage of the CETP including the raw materials used, quantity of the treatment water sent back to the units, quantity of the salts extracted from the treatment process and detail of the selling of such salts. All the above information shall be	<p>Complied.</p> <p>ETL is maintaining logbook (for existing operation 1.8 MLD) of</p> <ul style="list-style-type: none"> - Quantity and Quality of discharge of Effluent. - Record of Inflow to CETP. - Record of raw materials used, <p>Details are attached as below:</p> <p>It may be noted that ETL is not sending back treated water to member units and is also not extracting salt.</p> <p>EC Compliance report commission the above information is uploaded on website.</p> <p>We are having a digital display board in front of CETP, and all the required details are displayed.</p> <p>Details of the website are www.tatvaglobal.com.</p>																																																																						

provided on the line of the website exclusive prepared from the purpose by the CETP owner. The website shall be accessible by the public. The financial and energy details of the CETP will also be provided along with details of the workers of the CETP.

Industrial Effluent Inlet Quantity and Discharge quantity & quality: - (In-house Laboratory's results)

Month	Average Inlet Effluent (MLD) (1.8 MLD Industrial Effluent)	Final Discharge Quantity Along with 1.7 MLD sewage (Avg. MLD)	Final Discharge Effluent Quality				
			pH	COD	BOD	TSS	NH4-N
April'23	1.398	2.122	7.76	884	6.90	45.28	64.40
May'23	1.369	2.016	7.54	865.07	4.88	44.90	36.90
June'23	1.432	2.424	7.66	842	6.33	44.6	41.10
July'23	1.553	2.684	7.66	661	5	47.81	48.26
August'23	1.560	2.331	7.53	824.31	7.38	47.71	43.06
September'23	1.585	2.678	7.48	835.07	8.27	59.33	37.53

All parameters are in mg/l except pH.

Raw Material Consumption:

Chemicals	Apr.-23	May-23	June-23	July-23	Aug.-23	Sep.-23
Lime	44522	40018.6	45356.2	44663.6	45880	45391.8
H ₂ O ₂	65	135	0	0	0	0
FeSO ₄ (solid)	0	0	0	0	0	0
Polyelectrolyte	2	23	4	8	3	6
De foaming Agent	0	0	0	0	113	67
Fin Deform-18	6050	4100	5300	6220	5530	3700
Phosphoric Acid	500	750	750	500	770	750
Poly Aluminum Chloride (PAC)	225	185	295	378	367	359

		Sodium Tripolyphosphate (STTP)	143	145	125	75	50	62	
		MgCl₂	868	880	870	924	924	896	
		Na₂HPO₄	0	0	0	0	0	0	
		Caustic Soda (NaOH)	602.7	462.07	703.15	321.44	497.4	545.25	
IX.	The CETP shall have adequate power backup facility, to meet the energy requirement in case of the power failure from the grid.	<p>Complied.</p> <p>As power back ETL has installed D G Set of 1010 KVA for smooth operation during power failure.</p> <p>Existing Certificate attached as Annexure-1(E)</p>							
X.	The CETP owner shall study the water quality of the sea where the unit were earlier discharging the effluents. For the purpose, the CETP owner shall also monitor the sea water quality on daily basis as per CPCB norms. The information shall also be put on the above-mentioned site along with reasons for changes in seawater quality if any.	<p>Not applicable.</p> <p>ETL is sending their entire treated effluent to NCT-FETP for further treatment.</p>							
XI.	The ground water at the site shall also be monitored and information made available on the above website of the company.	<p>No ground water is utilized at site, water supply is from GIDC Notified Area Authority.</p>							
XII.	The CETP shall be accessible by the public to monitor the functioning the CETP.								

XIII.	The solid waste from CETP/units shall be disposed off as per the norms laid down by Gujarat pollution control board.	<p>Complied. Unit is disposing sludge to Common TSDF – BEIL. Sludge disposal quantity for existing facility is under: (April-23 to September-23).</p> <table border="1" data-bbox="608 347 1321 674"> <thead> <tr> <th>Month</th> <th>Sludge Quantity (MT)</th> <th>Consented Qty. in MT/Year</th> </tr> </thead> <tbody> <tr> <td>April-23</td> <td>204.55</td> <td rowspan="6">36500</td> </tr> <tr> <td>May-23</td> <td>224.32</td> </tr> <tr> <td>June-23</td> <td>272.20</td> </tr> <tr> <td>July-23</td> <td>247.23</td> </tr> <tr> <td>August-23</td> <td>299.44</td> </tr> <tr> <td>September-23</td> <td>295.27</td> </tr> </tbody> </table> <p>Membership certificate of BEIL to send sludge attached as Annexure -1(F)</p>	Month	Sludge Quantity (MT)	Consented Qty. in MT/Year	April-23	204.55	36500	May-23	224.32	June-23	272.20	July-23	247.23	August-23	299.44	September-23	295.27
Month	Sludge Quantity (MT)	Consented Qty. in MT/Year																
April-23	204.55	36500																
May-23	224.32																	
June-23	272.20																	
July-23	247.23																	
August-23	299.44																	
September-23	295.27																	
XIV.	All the above information shall be complied and a report shall be submitted to Gujarat pollution control board and regional office of MoEF at Bhopal.	<p>Complied. EC compliance report is submitted to Gujarat Pollution Control Board and also submitted to MOEF& CC Website.</p>																
XV.	The project proponent shall ensure that the facilities constructed for the project will not cause any inconvenience or disturbance to the local communities including the fisherman.	<p>Agree to Comply</p> <p>We will take care to ensure that our facility constructed will not cause any inconvenience or disturbance to the local communities including the fisherman.</p>																
XVI.	A modification of the project shall be taken up only after obtaining necessary approvals from the concerned agencies.	Noted for compliance.																

5. GENERAL CONDITION:

Sr. No	Description	Status
I.	Construction of the proposed CETP should be undertaken meticulously confirming to the existing central/local rules and regulation. All the construction designs/drawings reacting to the proposed construction activities must have approvals of the concerned State Government Department/Agencies.	<p>Noted.</p> <p>All the existing drawings have been approved from GIDC and Factory Inspector's office.</p> <p>All the drawings for the proposed 3.5 MLD will also be approved from the GIDC as well as factory inspector's office.</p>

II.	The project authorities should take appropriate community development and welfare measures for the villagers in the vicinity of the project site, including drinking water facilities, a separate fund should be allocated for this purpose and same indicated to regional office at Bhopal.																													
III.	To meet any emergency, appropriate fire-fighting system should be installed. Appropriate arrangement for uninterrupted power supply to the environment protection equipment and continuous water supply for the fire-fighting system should be made.	Complied. Fire-fighting system is already installed for existing facilities. D G Set of 1010 KVA also available in case of emergency during power cut.																												
IV.	A separate Environment management Cell with suitable qualified staff to carry out various environment related functions should be set up under the charge of senior Executive who will report directly to the Chief Executive of the company.	Complied. Details are as under: <table border="1" data-bbox="699 927 1489 1487"> <thead> <tr> <th data-bbox="699 927 778 1039">Sr. No.</th> <th data-bbox="778 927 1007 1039">Name of the employee</th> <th data-bbox="1007 927 1235 1039">Designation</th> <th data-bbox="1235 927 1489 1039">Educational Qualification</th> </tr> </thead> <tbody> <tr> <td data-bbox="699 1039 778 1106">1.</td> <td data-bbox="778 1039 1007 1106">Mr. B. D. Dalwadi</td> <td data-bbox="1007 1039 1235 1106">C.E.O.</td> <td data-bbox="1235 1039 1489 1106">B.E. Chemical</td> </tr> <tr> <td data-bbox="699 1106 778 1211">2.</td> <td data-bbox="778 1106 1007 1211">Mr. A. M. Darji</td> <td data-bbox="1007 1106 1235 1211">Unit Head</td> <td data-bbox="1235 1106 1489 1211">M.Sc.- Biochemistry, LL. B</td> </tr> <tr> <td data-bbox="699 1211 778 1317">3.</td> <td data-bbox="778 1211 1007 1317">Mr. Narendra B Patel</td> <td data-bbox="1007 1211 1235 1317">Sr. Manager (Q.A)</td> <td data-bbox="1235 1211 1489 1317">M. Sc & PG Dip in Env. Mgt. & Tech.</td> </tr> <tr> <td data-bbox="699 1317 778 1384">4.</td> <td data-bbox="778 1317 1007 1384">Mr. Akhil P. Kharkhanis</td> <td data-bbox="1007 1317 1235 1384">Unit Head</td> <td data-bbox="1235 1317 1489 1384">M.E. Chemical</td> </tr> <tr> <td data-bbox="699 1384 778 1451">5.</td> <td data-bbox="778 1384 1007 1451">Ms. Rakshita Vyas</td> <td data-bbox="1007 1384 1235 1451">Manager (Env.)</td> <td data-bbox="1235 1384 1489 1451">M.Sc. Environment</td> </tr> <tr> <td data-bbox="699 1451 778 1487">6.</td> <td data-bbox="778 1451 1007 1487">Ms. Priya Patel</td> <td data-bbox="1007 1451 1235 1487">Officer (Env.)</td> <td data-bbox="1235 1451 1489 1487">B.E. Environment</td> </tr> </tbody> </table>	Sr. No.	Name of the employee	Designation	Educational Qualification	1.	Mr. B. D. Dalwadi	C.E.O.	B.E. Chemical	2.	Mr. A. M. Darji	Unit Head	M.Sc.- Biochemistry, LL. B	3.	Mr. Narendra B Patel	Sr. Manager (Q.A)	M. Sc & PG Dip in Env. Mgt. & Tech.	4.	Mr. Akhil P. Kharkhanis	Unit Head	M.E. Chemical	5.	Ms. Rakshita Vyas	Manager (Env.)	M.Sc. Environment	6.	Ms. Priya Patel	Officer (Env.)	B.E. Environment
Sr. No.	Name of the employee	Designation	Educational Qualification																											
1.	Mr. B. D. Dalwadi	C.E.O.	B.E. Chemical																											
2.	Mr. A. M. Darji	Unit Head	M.Sc.- Biochemistry, LL. B																											
3.	Mr. Narendra B Patel	Sr. Manager (Q.A)	M. Sc & PG Dip in Env. Mgt. & Tech.																											
4.	Mr. Akhil P. Kharkhanis	Unit Head	M.E. Chemical																											
5.	Ms. Rakshita Vyas	Manager (Env.)	M.Sc. Environment																											
6.	Ms. Priya Patel	Officer (Env.)	B.E. Environment																											
V.	The funds earmarked for environment protection measures shall be maintained in a separate account and there shall be no diversion of these funds for any other purpose. A year-wise expenditure on environment safeguards shall be reported to this Ministry's regional office at Bhopal.	Noted for compliance. Our unit is a CETP and hence all the expenditure is for the purpose of environment protection measures.																												
VI.	Full support shall be extended to the officers of the Ministry's Regional Office at Bhopal and the officer of the central and State pollution control Board by the project proponent during their	Complied.																												

	inspection for monitoring purpose, but furnishing full details and action plans including the action taken reports in respect of mitigative measures another environment protection activities.	
VII.	In case of deviation or alternation in the project including the implementing agency, a fresh reference should be made to this Ministry for modification in the clearance conditions or imposition of new one for ensuring environmental protection.	In case of deviation or alteration in the project including the implementing agency, we agree to give a fresh reference to the Ministry for modification in the clearance conditions or imposition of new one for ensuring environmental protection.
VIII.	This Ministry reserves the right to revoke this clearance, if any of the conditions stipulated are not complies with to the satisfaction of this ministry.	Noted.
IX.	This ministry or any other competent authority any stipulate any other additional conditions subsequently, if deemed necessary for environment protection, which shall be complied with.	Noted.
X.	State Pollution Control Board/Committee shall display a copy of the clearance letter at the District Industries Center and Collector's office/ Tehsildar's office for 30 days.	Pertains to SPCB. Hence, compliance not applicable to us.
XI.	The project proponent shall inform regional Office Bhopal as well as the Ministry, the date of financial approval of the project by the concerned authorities and the date of start of work.	Noted

Condition No.	Description	Status
7.	<p>The above-mentioned stipulations shall be enforced among others under the water(prevention and control of pollution) Act 1974, the Air (prevention and control of pollution) Act 1981, the Environment(protection) Act 1986, the Hazardous Chemicals (manufacture, Storage and Import) Rules, 1986, the Coastal Regulation Zone Notification, 1991 and its subsequent amendments and the public liability Insurance act,1991 and the Rules made under from time to time. The proponent shall also ensure that proposal complies with the provisions of the approved Costal Regional Zone Management Plan of Gujarat and the supreme court's order dated 18th April 1996 in the writ petition N.664 of 1993 to the extent the same are applicable to the proposal.</p>	
8.	<p>All other statutory clearance such as the approvals for the storage of diesel from chief Controller of Explosive, Fire Department, Civil Aviation Department, Forest Conservation Act, 1972 etc. shall be obtained, as applicable by project proponent from the respective competent authorities.</p>	
9.	<p>The project proponent should advertise in at least two local Newspaper widely circulated in the region, one of which shall be in vernacular language informing that the project has been accorded Environment Clearance and copies of clearance letter are available with Maharashtra pollution Control Board and may also been seen on the website of the Ministry of Environment and Forests at http://www.envfor.nic.in . the advertisement should be made within 10 days from the date of receipt of the clearance letter</p>	<p>Complied. We have advertised in two local newspapers (Times of India and Gujarat Mitra) on date 09th August 2009 informing that the “project has been accorded EC”. Copy is attached as Annexure - 1 (G)</p>

	and a copy of the same should be forwarded to the regional office of this Ministry at Bhopal.	
10.	A copy of the clearance letter shall be sent by the proponent to concerned panchayat, Zilla Parisad/municipal Corporation, Urban Local body and the local NGO, if any from whom suggestions/representations, if any, were received while the proposal. The clearance letter shall also be put on the website of the company by the proponent	Complied. We have submitted the copy of EC to concerned panchayat, Zilla Parisad/municipal Corporation, Urban Local body, and the local NGO Acknowledgement sheet attached as Annexure-1 (G)
11.	The proponent shall upload the status of compliance of the stipulated EC conditions, including results of monitored data on their website and shall update the same periodically. It shall simultaneously be sent to Regional Office of MoEF, the respective Zonal Office of CPCB and the SPCB. The criteria pollutant level namely; SPM, RSPM, SO ₂ , NO _x (ambient levels as well as stack emissions) or critical sectoral parameters, indicated for the project shall be monitored and displayed at a convenient location near the main gate of the company in the public domain,	Complied.



NARMADA CLEAN TECH

(A Subsidiary of GIDC)

F/OPN/07

Report No : NCT/MIAR/2023/APR/N-124

Report Date : 08/04/2023

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water		
Sample Quantity:	500 ml	Sampling By:	Dev
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	07/04/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	NCT/QC/WI/22
Packing Details:	Plastic Bottle	Analysis Start Date:	07/04/2023
Customer Sample Id	N-11	Analysis Completion Date:	07/04/2023
Sampling Start Date & Time:	07/04/2023 0:50	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	8	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	551	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	42	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	18888	APHA 2540 C
5	Total Suspended Solid	mg/lit	41	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech Analytical Laboratory; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the NCT Analytical Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of NCT Analytical Laboratory.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



NARMADA CLEAN TECH

(A Subsidiary of GIDC)

F/OPN/07

Report No : NCT/MIAR/2023/APR/N-243

Report Date : 13/04/2023

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water		
Sample Quantity:	500 ml	Sampling By:	Dev
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	12/04/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	NCT/QC/WI/22
Packing Details:	Plastic Bottle	Analysis Start Date:	12/04/2023
Customer Sample Id	N-13	Analysis Completion Date:	12/04/2023
Sampling Start Date & Time:	12/04/2023 1:16	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.89	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	618	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	46	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	26600	APHA 2540 C
5	Total Suspended Solid	mg/lit	68	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech Analytical Laboratory; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the NCT Analytical Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of NCT Analytical Laboratory.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



NARMADA CLEAN TECH

(A Subsidiary of GIDC)

F/OPN/07

Report No : NCT/MIAR/2023/APR/N-353

Report Date : 18/04/2023

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water		
Sample Quantity:	500 ml	Sampling By:	Rajesh
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	17/04/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	NCT/QC/WI/22
Packing Details:	Plastic Bottle	Analysis Start Date:	17/04/2023
Customer Sample Id	N-13	Analysis Completion Date:	17/04/2023
Sampling Start Date & Time:	17/04/2023 0:38	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.52	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	736	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	38	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	18486	APHA 2540 C
5	Total Suspended Solid	mg/lit	54	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech Analytical Laboratory; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the NCT Analytical Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of NCT Analytical Laboratory.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



NARMADA CLEAN TECH

(A Subsidiary of GIDC)

F/OPN/07

Report No : NCT/MIAR/2023/APR/N-463

Report Date : 23/04/2023

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water		
Sample Quantity:	500 ml	Sampling By:	F.S.Shaikh
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	22/04/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	NCT/QC/WI/22
Packing Details:	Plastic Bottle	Analysis Start Date:	22/04/2023
Customer Sample Id	N-9	Analysis Completion Date:	22/04/2023
Sampling Start Date & Time:	21/04/2023 11:00	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.37	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	610	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	24	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	30126	APHA 2540 C
5	Total Suspended Solid	mg/lit	62	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech Analytical Laboratory; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the NCT Analytical Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of NCT Analytical Laboratory.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



NARMADA CLEAN TECH

(A Subsidiary of GIDC)

F/OPN/07

Report No : NCT/MIAR/2023/APR/N-524

Report Date : 26/04/2023

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water		
Sample Quantity:	500 ml	Sampling By:	F.S.Shaikh
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	25/04/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	NCT/QC/WI/22
Packing Details:	Plastic Bottle	Analysis Start Date:	25/04/2023
Customer Sample Id	N-4	Analysis Completion Date:	25/04/2023
Sampling Start Date & Time:	24/04/2023 11:06	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.56	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	677	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	44	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	24816	APHA 2540 C
5	Total Suspended Solid	mg/lit	41	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech Analytical Laboratory; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the NCT Analytical Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of NCT Analytical Laboratory.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



NARMADA CLEAN TECH

(A Subsidiary of GIDC)

F/OPN/07

Report No : NCT/MIAR/2023/APR/N-644

Report Date : 02/05/2023

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water		
Sample Quantity:	500 ml	Sampling By:	Manish
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	01/05/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	NCT/QC/WI/22
Packing Details:	Plastic Bottle	Analysis Start Date:	01/05/2023
Customer Sample Id	N-2	Analysis Completion Date:	01/05/2023
Sampling Start Date & Time:	30/04/2023 10:51	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.24	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	715	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	46	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	21492	APHA 2540 C
5	Total Suspended Solid	mg/lit	49	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech Analytical Laboratory; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the NCT Analytical Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of NCT Analytical Laboratory.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



NARMADA CLEAN TECH

(A Subsidiary of GIDC)

F/OPN/07

Report No : NCT/MIAR/2023/MAY/N-55

Report Date : 05/05/2023

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water		
Sample Quantity:	500 ml	Sampling By:	F.S.Shaikh
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	04/05/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	NCT/QC/WI/22
Packing Details:	Plastic Bottle	Analysis Start Date:	04/05/2023
Customer Sample Id	N-3	Analysis Completion Date:	04/05/2023
Sampling Start Date & Time:	03/05/2023 10:51	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.27	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	709	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	31	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	28458	APHA 2540 C
5	Total Suspended Solid	mg/lit	54	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech Analytical Laboratory; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the NCT Analytical Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of NCT Analytical Laboratory.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



NARMADA CLEAN TECH

(A Subsidiary of GIDC)

F/OPN/07

Report No : NCT/MIAR/2023/MAY/N-212

Report Date : 11/05/2023

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water		
Sample Quantity:	500 ml	Sampling By:	Dev
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	10/05/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	NCT/QC/WI/22
Packing Details:	Plastic Bottle	Analysis Start Date:	10/05/2023
Customer Sample Id	N-8	Analysis Completion Date:	10/05/2023
Sampling Start Date & Time:	09/05/2023 19:43	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.24	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	645	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	30	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	17978	APHA 2540 C
5	Total Suspended Solid	mg/lit	46	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech Analytical Laboratory; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the NCT Analytical Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of NCT Analytical Laboratory.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



NARMADA CLEAN TECH

(A Subsidiary of GIDC)

F/OPN/07

Report No : NCT/MIAR/2023/MAY/N-239

Report Date : 12/05/2023

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water		
Sample Quantity:	500 ml	Sampling By:	F.S.Shaikh
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	11/05/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	NCT/QC/WI/22
Packing Details:	Plastic Bottle	Analysis Start Date:	11/05/2023
Customer Sample Id	N-12	Analysis Completion Date:	11/05/2023
Sampling Start Date & Time:	11/05/2023 1:30	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.36	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	674	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	28	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	19238	APHA 2540 C
5	Total Suspended Solid	mg/lit	54	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech Analytical Laboratory; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the NCT Analytical Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of NCT Analytical Laboratory.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



NARMADA CLEAN TECH

(A Subsidiary of GIDC)



F/OPN/07

Report No : NCT/MIAR/2023/MAY/N-642

Report Date : 02/06/2023

URL No. : TC1159823000000241F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	500 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	01/06/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Plastic Bottle	Analysis Start Date:	01/06/2023
Customer Sample Id	N-10	Analysis Completion Date:	01/06/2023
Sampling Start Date & Time:	31/05/2023 11:28	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.37	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	758	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	27	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	21306	APHA 2540 C
5	Total Suspended Solid	mg/lit	62	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the NCT Analytical Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of NCT Analytical Laboratory.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling

Surti Bhagor, Nr. Gujarat Gas Office, Umarwada Road, Ankleshwar-393 001, Dist. Bharuch (Gujarat)

Tele : 8469745285, Email : info@nctc.co.in; website : www.nctc.co.in, CIN : U140101GJ2000NPL037236



NARMADA CLEAN TECH

(A Subsidiary of GIDC)



F/OPN/07

Report No : NCT/MIAR/2023/JUNE/N-78

Report Date : 06/06/2023

URL No. : TC1159823000000352F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	500 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	05/06/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Plastic Bottle	Analysis Start Date:	05/06/2023
Customer Sample Id	N-8	Analysis Completion Date:	05/06/2023
Sampling Start Date & Time:	04/06/2023 17:29	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.27	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	763	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	36	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	19218	APHA 2540 C
5	Total Suspended Solid	mg/lit	33	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the NCT Analytical Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of NCT Analytical Laboratory.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



NARMADA CLEAN TECH

(A Subsidiary of GIDC)



F/OPN/07

Report No : NCT/MIAR/2023/JUNE/N-166

Report Date : 10/06/2023

URL No. : TC1159823000000447F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	500 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	09/06/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Plastic Bottle	Analysis Start Date:	09/06/2023
Customer Sample Id	N-5	Analysis Completion Date:	09/06/2023
Sampling Start Date & Time:	08/06/2023 20:05	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.19	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	864	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	33	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	19920	APHA 2540 C
5	Total Suspended Solid	mg/lit	45	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the NCT Analytical Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of NCT Analytical Laboratory.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



NARMADA CLEAN TECH

(A Subsidiary of GIDC)



F/OPN/07

Report No : NCT/MIAR/2023/JUNE/N-238

Report Date : 13/06/2023

URL No. : TC1159823000000522F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	500 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	12/06/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Plastic Bottle	Analysis Start Date:	12/06/2023
Customer Sample Id	N-9	Analysis Completion Date:	12/06/2023
Sampling Start Date & Time:	12/06/2023 0:49	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.18	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	790	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	30	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	22186	APHA 2540 C
5	Total Suspended Solid	mg/lit	43	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the NCT Analytical Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of NCT Analytical Laboratory.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



NARMADA CLEAN TECH

(A Subsidiary of GIDC)



F/OPN/07

Report No : NCT/MIAR/2023/JUNE/N-308

Report Date : 16/06/2023

URL No. : TC1159823000000592F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	500 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	15/06/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Plastic Bottle	Analysis Start Date:	15/06/2023
Customer Sample Id	N-13	Analysis Completion Date:	15/06/2023
Sampling Start Date & Time:	15/06/2023 1:22	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.28	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	792	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	30	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	21222	APHA 2540 C
5	Total Suspended Solid	mg/lit	52	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the NCT Analytical Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of NCT Analytical Laboratory.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



NARMADA CLEAN TECH

(A Subsidiary of GIDC)



F/OPN/07

Report No : NCT/MIAR/2023/JUNE/N-492

Report Date : 25/06/2023

URL No. : TC1159823000000796F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	500 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	24/06/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Plastic Bottle	Analysis Start Date:	24/06/2023
Customer Sample Id	N-1	Analysis Completion Date:	24/06/2023
Sampling Start Date & Time:	23/06/2023 9:55	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.05	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	769	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	46	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	22796	APHA 2540 C
5	Total Suspended Solid	mg/lit	56	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the NCT Analytical Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of NCT Analytical Laboratory.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



NARMADA CLEAN TECH

(A Subsidiary of GIDC)



F/OPN/07

Report No : NCT/MIAR/2023/JUNE/N-545

Report Date : 27/06/2023

URL No. : TC1159823000000849F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	500 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	26/06/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Plastic Bottle	Analysis Start Date:	26/06/2023
Customer Sample Id	N-11	Analysis Completion Date:	26/06/2023
Sampling Start Date & Time:	25/06/2023 20:31	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.19	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	755	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	46	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	21492	APHA 2540 C
5	Total Suspended Solid	mg/lit	51	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the NCT Analytical Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of NCT Analytical Laboratory.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



NARMADA CLEAN TECH

(A Subsidiary of GIDC)



F/OPN/07

Report No : NCT/MIAR/2023/JUNE/N-601

Report Date : 30/06/2023

URL No. : TC1159823000000915F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	500 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	29/06/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Plastic Bottle	Analysis Start Date:	29/06/2023
Customer Sample Id	N-5	Analysis Completion Date:	29/06/2023
Sampling Start Date & Time:	28/06/2023 10:59	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.25	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	796	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	42	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	20120	APHA 2540 C
5	Total Suspended Solid	mg/lit	45	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the NCT Analytical Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of NCT Analytical Laboratory.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



NARMADA CLEAN TECH

(A Subsidiary of GIDC)



F/OPN/07

Report No : NCT/MIAR/2023/JULY/N-115

Report Date : 08/07/2023

URL No. : TC1159823000001094F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	500 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	07/07/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Plastic Bottle	Analysis Start Date:	07/07/2023
Customer Sample Id	N-14	Analysis Completion Date:	07/07/2023
Sampling Start Date & Time:	07/07/2023 2:40	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.19	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	610	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	49	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	18232	APHA 2540 C
5	Total Suspended Solid	mg/lit	71	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the NCT Analytical Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of NCT Analytical Laboratory.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



F/OPN/07

Report No : NCT/MIAR/2023/JULY/N-197

Report Date : 12/07/2023

URL No. : TC1159823000001203F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	500 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	11/07/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Plastic Bottle	Analysis Start Date:	11/07/2023
Customer Sample Id	N-10	Analysis Completion Date:	11/07/2023
Sampling Start Date & Time:	11/07/2023 2:33	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.42	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	682	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	55	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	17386	APHA 2540 C
5	Total Suspended Solid	mg/lit	48	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



F/OPN/07

Report No : NCT/MIAR/2023/JULY/N-339

Report Date : 21/07/2023

URL No. : TC1159823000001357F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	500 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	20/07/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Plastic Bottle	Analysis Start Date:	20/07/2023
Customer Sample Id	N-5	Analysis Completion Date:	20/07/2023
Sampling Start Date & Time:	20/07/2023 1:48	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.44	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	624	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	40	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	16674	APHA 2540 C
5	Total Suspended Solid	mg/lit	52	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



F/OPN/07

Report No : NCT/MIAR/2023/JULY/N-395

Report Date : 24/07/2023

URL No. : TC1159823000001413F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	500 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	23/07/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Plastic Bottle	Analysis Start Date:	23/07/2023
Customer Sample Id	N-7	Analysis Completion Date:	23/07/2023
Sampling Start Date & Time:	22/07/2023 17:07	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.25	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	608	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	41	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	16558	APHA 2540 C
5	Total Suspended Solid	mg/lit	30	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



F/OPN/07

Report No : NCT/MIAR/2023/AUG/N-112

Report Date : 08/08/2023

URL No. : TC1159823000001723F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	500 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	07/08/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Plastic Bottle	Analysis Start Date:	07/08/2023
Customer Sample Id	N-6	Analysis Completion Date:	07/08/2023
Sampling Start Date & Time:	06/08/2023 23:23	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.03	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	800	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	41	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	17686	APHA 2540 C
5	Total Suspended Solid	mg/lit	58	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



F/OPN/07

Report No : NCT/MIAR/2023/AUG/N-223

Report Date : 13/08/2023

URL No. : TC1159823000001846F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	500 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	12/08/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Plastic Bottle	Analysis Start Date:	12/08/2023
Customer Sample Id	N-11	Analysis Completion Date:	12/08/2023
Sampling Start Date & Time:	12/08/2023 2:58	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	774	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	42	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	21784	APHA 2540 C
5	Total Suspended Solid	mg/lit	46	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



F/OPN/07

Report No : NCT/MIAR/2023/AUG/N-422

Report Date : 23/08/2023

URL No. : TC1159823000002053F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	500 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	22/08/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Plastic Bottle	Analysis Start Date:	22/08/2023
Customer Sample Id	N-10	Analysis Completion Date:	22/08/2023
Sampling Start Date & Time:	22/08/2023 1:01	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	6.94	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	712	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	26	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	18274	APHA 2540 C
5	Total Suspended Solid	mg/lit	38	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



F/OPN/07

Report No : NCT/MIAR/2023/AUG/N-478

Report Date : 26/08/2023

URL No. : TC1159823000002114F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	500 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	25/08/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Plastic Bottle	Analysis Start Date:	25/08/2023
Customer Sample Id	N-11	Analysis Completion Date:	25/08/2023
Sampling Start Date & Time:	25/08/2023 0:53	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.06	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	766	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	35	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	19500	APHA 2540 C
5	Total Suspended Solid	mg/lit	39	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



F/OPN/07

Report No : NCT/MIAR/2023/SEPT/N-48

Report Date : 06/09/2023

URL No. : TC1159823000002306F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	500 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	05/09/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Plastic Bottle	Analysis Start Date:	05/09/2023
Customer Sample Id	N-5	Analysis Completion Date:	05/09/2023
Sampling Start Date & Time:	04/09/2023 0:23	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.06	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	784	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	34	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	17800	APHA 2540 C
5	Total Suspended Solid	mg/lit	42	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



F/OPN/07

Report No : NCT/MIAR/2023/SEPT/N-174

Report Date : 12/09/2023

URL No. : TC1159823000002437F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	500 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	11/09/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Plastic Bottle	Analysis Start Date:	11/09/2023
Customer Sample Id	N-10	Analysis Completion Date:	11/09/2023
Sampling Start Date & Time:	11/09/2023 1:06	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.08	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	776	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	39	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	15888	APHA 2540 C
5	Total Suspended Solid	mg/lit	39	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



F/OPN/07

Report No : NCT/MIAR/2023/SEPT/N-273

Report Date : 17/09/2023

URL No. : TC1159823000002541F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	500 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	16/09/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Plastic Bottle	Analysis Start Date:	16/09/2023
Customer Sample Id	N-2	Analysis Completion Date:	16/09/2023
Sampling Start Date & Time:	15/09/2023 10:49	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.02	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	738	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	40	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	18484	APHA 2540 C
5	Total Suspended Solid	mg/lit	63	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



Analytical Laboratory
NARMADA CLEAN TECH
(A Subsidiary of GIDC)



F/OPN/07

Report No : NCT/MIAR/2023/SEPT/N-407

Report Date : 24/09/2023

URL No. : TC1159823000002686F

To :

ENVIRO TECHNOLOGY LIMITED

Plot No: 2413/14, GIDC ESTATE

ANKLESHWAR 393 002.

TEST REPORT

Kindly find here with the Test report.

Sample Description:	Waste Water	Sample Quantity:	500 ml
Sampling Location:	Free flow sample from Final Discharge Point	Sample Received Date:	23/09/2023
Sample Received By:	Mr. Upendra Rout	Sampling Plan & Procedure:	N.A.
Packing Details:	Plastic Bottle	Analysis Start Date:	23/09/2023
Customer Sample Id	N-3	Analysis Completion Date:	23/09/2023
Sampling Start Date & Time:	22/09/2023 12:56	Sample Type:	Waste Water Sample

Sr No.	Parameter	Unit	Results	Method Ref.
1	pH at Room Temperature	~	7.03	APHA 4500 H B
2	Chemical Oxygen Demand	mg/lit	771	APHA 5220 B
3	Ammonical Nitrogen	mg/lit	33	APHA 4500 NH3C
4	Total Dissolved Solid	mg/lit	18256	APHA 2540 C
5	Total Suspended Solid	mg/lit	19	APHA 2540 D

Remarks :

Terms and conditions governing the test report issued

1. Sample is drawn by Narmada Clean Tech ; the results are applicable only to the Received samples from Customer.
2. The test report shall not be reproduced in full or part without the written approval of the Analytical Laboratory Narmada Clean Tech.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of Analytical Laboratory Narmada Clean Tech.
4. Waste water samples shall be stored for the period of Fifteen days after the date of issue of Report.

----- End of Report -----

For Narmada Clean Tech

Authorized By

Dipali Mehta
Sr. Executive QCD

Note: Joint Analysis will be entertained within 15 days from the date of sampling



National Accreditation Board for
Testing and Calibration Laboratories

CERTIFICATE OF ACCREDITATION

**ANALYTICAL LABORATORY, ENVIRO TECHNOLOGY
LIMITED**

has been assessed and accredited in accordance with the standard

ISO/IEC 17025:2017

**"General Requirements for the Competence of Testing &
Calibration Laboratories"**

for its facilities at

PLOT NO.2413/14, GIDC ESTATE, ANKLESHWAR, BHARUCH, GUJARAT, INDIA

in the field of

TESTING

Certificate Number: TC-5466

Issue Date: 14/03/2023

Valid Until:

13/03/2025

This certificate remains valid for the Scope of Accreditation as specified in the annexure subject to continued satisfactory compliance to the above standard & the relevant requirements of NABL.

(To see the scope of accreditation of this laboratory, you may also visit NABL website www.nabl-india.org)

Name of Legal Identity : ENVIRO TECHNOLOGY LIMITED

Signed for and on behalf of NABL



N. Venkateswaran
Chief Executive Officer



PRIME INSTITUTE OF ENGINEERING & TECHNOLOGY

(Governed by Smt. Nirmaladevi Rukmanidevi Trust, Surat.)

Approved by AICTE, New Delhi & Affiliated to Gujarat Technological University, Ahmedabad.

GTU CORD : 134

TEST REPORT: WATER

Test Report No.: PIET/ERTL/2023-24/31

Issue Date: 28/08/2023

Customer Details

Name: M/s. Enviro Technology Ltd. (CETP of ETL)
Address: Plot No: 2413-2414, GIDC Ankleshwar, Dist: Bharuch
Contact Person Name: Mr. A. M. Darji
Contact Details: 9825403247

Test Sample Details

Location of Sampling : High Ammonia stream inlet
Laboratory UID of Sample: PIET/ERTL/W/WW/2023-24/107
Date of Sampling: 11/08/2023
Sample Receipt Date: 12/08/2023
Sample Collected By: PIET Team

Sample Identity: Wastewater
Purpose of Sampling: Environment Audit 1st monitoring
Sampling Procedure: IS 3025 (Part-I): Grab
Analysis Start Date: 12/08/2023
Analysis End Date: 19/08/2023

TEST RESULT

Sr. No.	Parameter	Unit	Result	Test/Sampling Method
1.	pH	pH unit @ 25°C	8.38	Standard Methods, 24 th Ed. Part 4500 B.
2.	Temperature	°C	32	Standard Methods, 24 th Ed. Part 2550
3.	Total Dissolved Solids Dried at 180°C	mg/L	24464	Standard Methods, 24 th Ed. Part 2540 C.
4.	Total Suspended Solids Dried at 105 °C	mg/L	276	Standard Methods, 24 th Ed. Part 2540 D.
5.	Chemical Oxygen Demand	mg/L	4200	Standard Methods, 24th Ed. Part 5220B.
6.	Biochemical Oxygen Demand	mg/L	1651	IS:3025 (Part-44)- 1993 Reaffirmed 2019
7.	Ammonical Nitrogen	mg/L	267.76	Standard Methods, 24th Ed. Part 4500-NH ³ C & F.

Sample Analyzed By:

Mrs. Ranjana Mutrak
(Environmental Chemist,
Environmental Research & Testing
Laboratory)

Reviewed & Authorized By:

Mrs. Kamini Prajapati
(Environmental Engineer,
Environmental Research & Testing
Laboratory)

-----END OF THE REPORT-----

NOTE:

1. The results relate only to the samples tested.
2. The report shall not be reproduced except in full, without the written approval of the laboratory.



PRIME INSTITUTE OF ENGINEERING & TECHNOLOGY

(Governed by Smt. Nirmaladevi Rukmanidevi Trust, Surat.)

Approved by AICTE, New Delhi & Affiliated to Gujarat Technological University, Ahmedabad.

GTU CORD : 134

TEST REPORT: WATER

Test Report No.: PIET/ERTL/2023-24/32

Issue Date: 28/08/2023

Customer Details

Name: M/s. Enviro Technology Ltd. (CETP of ETL)
Address: Plot No: 2413-2414, GIDC Ankleshwar, Dist: Bharuch
Contact Person Name: Mr. A. M. Darji
Contact Details: 9825403247

Test Sample Details

Location of Sampling : ETP General Inlet
Laboratory UID of Sample: PIET/ERTL/W/WW/2023-24/108
Date of Sampling: 11/08/2023
Sample Receipt Date: 12/08/2023
Sample Collected By: PIET Team

Sample Identity: Wastewater
Purpose of Sampling: Environment Audit 1st monitoring
Sampling Procedure: IS 3025 (Part-I): Grab
Analysis Start Date: 12/08/2023
Analysis End Date: 19/08/2023

TEST RESULT

Sr. No.	Parameter	Unit	Result	Test/Sampling Method
1.	pH	pH unit @ 25°C	6.76	Standard Methods, 24 th Ed. Part 4500 B.
2.	Temperature	°C	32	Standard Methods, 24 th Ed. Part 2550
3.	Total Dissolved Solids Dried at 180°C	mg/L	27728	Standard Methods, 24 th Ed. Part 2540 C.
4.	Total Suspended Solids Dried at 105 °C	mg/L	854	Standard Methods, 24 th Ed. Part 2540 D.
5.	Chemical Oxygen Demand	mg/L	2480	Standard Methods, 24th Ed. Part 5220B.
6.	Biochemical Oxygen Demand	mg/L	841	IS:3025 (Part-44)- 1993 Reaffirmed 2019
7.	Ammonical Nitrogen	mg/L	30.76	Standard Methods, 24th Ed. Part 4500-NH ³ C & F.

Sample Analyzed By:

Mrs. Ranjana Mutrak
(Environmental Chemist,
Environmental Research & Testing
Laboratory)

Reviewed & Authorized By:

Mrs. Kamini Prajapati
(Environmental Engineer,
Environmental Research & Testing
Laboratory)

-----END OF THE REPORT-----

NOTE:

1. The results relate only to the samples tested.
2. The report shall not be reproduced except in full, without the written approval of the laboratory.



PRIME INSTITUTE OF ENGINEERING & TECHNOLOGY

(Governed by Smt. Nirmaladevi Rukmanidevi Trust, Surat.)

Approved by AICTE, New Delhi & Affiliated to Gujarat Technological University, Ahmedabad.

GTU CORD : 134

TEST REPORT: WATER

Test Report No.: PIET/ERTL/2023-24/33

Issue Date: 28/08/2023

Customer Details

Name: M/s. Enviro Technology Ltd. (CETP of ETL)
Address: Plot No: 2413-2414, GIDC Ankleshwar, Dist: Bharuch
Contact Person Name: Mr. A. M. Darji
Contact Details: 9825403247

Test Sample Details

Location of Sampling : Secondary outlet
Laboratory UID of Sample: PIET/ERTL/W/WW/2023-24/109
Date of Sampling: 11/08/2023
Sample Receipt Date: 12/08/2023
Sample Collected By: PIET Team

Sample Identity: Wastewater
Purpose of Sampling: Environment Audit 1st monitoring
Sampling Procedure: IS 3025 (Part-I): Grab
Analysis Start Date: 12/08/2023
Analysis End Date: 19/08/2023

TEST RESULT

Sr. No.	Parameter	Unit	Result	Test/Sampling Method
1.	pH	pH unit @ 25°C	6.78	Standard Methods, 24 th Ed. Part 4500 B.
2.	Temperature	°C	32	Standard Methods, 24 th Ed. Part 2550
3.	Total Dissolved Solids Dried at 180°C	mg/L	19468	Standard Methods, 24 th Ed. Part 2540 C.
4.	Total Suspended Solids Dried at 105 °C	mg/L	158	Standard Methods, 24 th Ed. Part 2540 D.
5.	Chemical Oxygen Demand	mg/L	960	Standard Methods, 24th Ed. Part 5220B.
6.	Biochemical Oxygen Demand	mg/L	19	IS:3025 (Part-44)- 1993 Reaffirmed 2019
7.	Ammonical Nitrogen	mg/L	28.46	Standard Methods, 24th Ed. Part 4500-NH ³ C & F.

Sample Analyzed By:

Mrs. Ranjana Mutrak
(Environmental Chemist,
Environmental Testing & Research
Laboratory)

Reviewed & Authorized By:

Mrs. Kamini Prajapati
(Environmental Engineer,
Environmental Testing & Research
Laboratory)

-----END OF THE REPORT-----

NOTE:

1. The results relate only to the samples tested.
2. The report shall not be reproduced except in full, without the written approval of the laboratory.



PRIME INSTITUTE OF ENGINEERING & TECHNOLOGY

(Governed by Smt. Nirmaladevi Rukmanidevi Trust, Surat.)

Approved by AICTE, New Delhi & Affiliated to Gujarat Technological University, Ahmedabad.

GTU CORD : 134

TEST REPORT: WATER

Test Report No.: PIET/ERTL/2023-24/34

Issue Date: 28/08/2023

Customer Details

Name: M/s. Enviro Technology Ltd. (CETP of ETL)
Address: Plot No: 2413-2414, GIDC Ankleshwar, Dist: Bharuch
Contact Person Name: Mr. A. M. Darji
Contact Details: 9825403247

Test Sample Details

Location of Sampling : ETP final outlet
Laboratory UID of Sample: PIET/ERTL/W/WW/2023-24/110
Date of Sampling: 11/08/2023
Sample Receipt Date: 12/08/2023
Sample Collected By: PIET Team

Sample Identity: Wastewater
Purpose of Sampling: Environment Audit 1st monitoring
Sampling Procedure: IS 3025 (Part-I): Grab
Analysis Start Date: 12/08/2023
Analysis End Date: 19/08/2023

TEST RESULT

Sr. No.	Parameter	Unit	Result	Permissible limit	Test/Sampling Method
1.	pH	pH unit @ 25°C	7.18	6.5 to 8.5	Standard Methods, 24 th Ed. Part 4500 B.
2.	Temperature	°C	34	40	Standard Methods, 24 th Ed. Part 2550
3.	Total Dissolved Solids Dried at 180°C	mg/L	19822	10000	Standard Methods, 24 th Ed. Part 2540 C.
4.	Total Suspended Solids Dried at 105 °C	mg/L	50	150	Standard Methods, 24 th Ed. Part 2540 D.
5.	Chemical Oxygen Demand	mg/L	920	1000	Standard Methods, 24th Ed. Part 5220B.
6.	Biochemical Oxygen Demand	mg/L	14	200	IS:3025 (Part-44)- 1993 Reaffirmed 2019
7.	Ammonical Nitrogen	mg/L	26.18	50	Standard Methods, 24th Ed. Part 4500-NH ³ C & F.

Sample Analyzed By:

Mrs. Ranjana Mutrak
(Environmental Chemist,
Environmental Testing & Research
Laboratory)

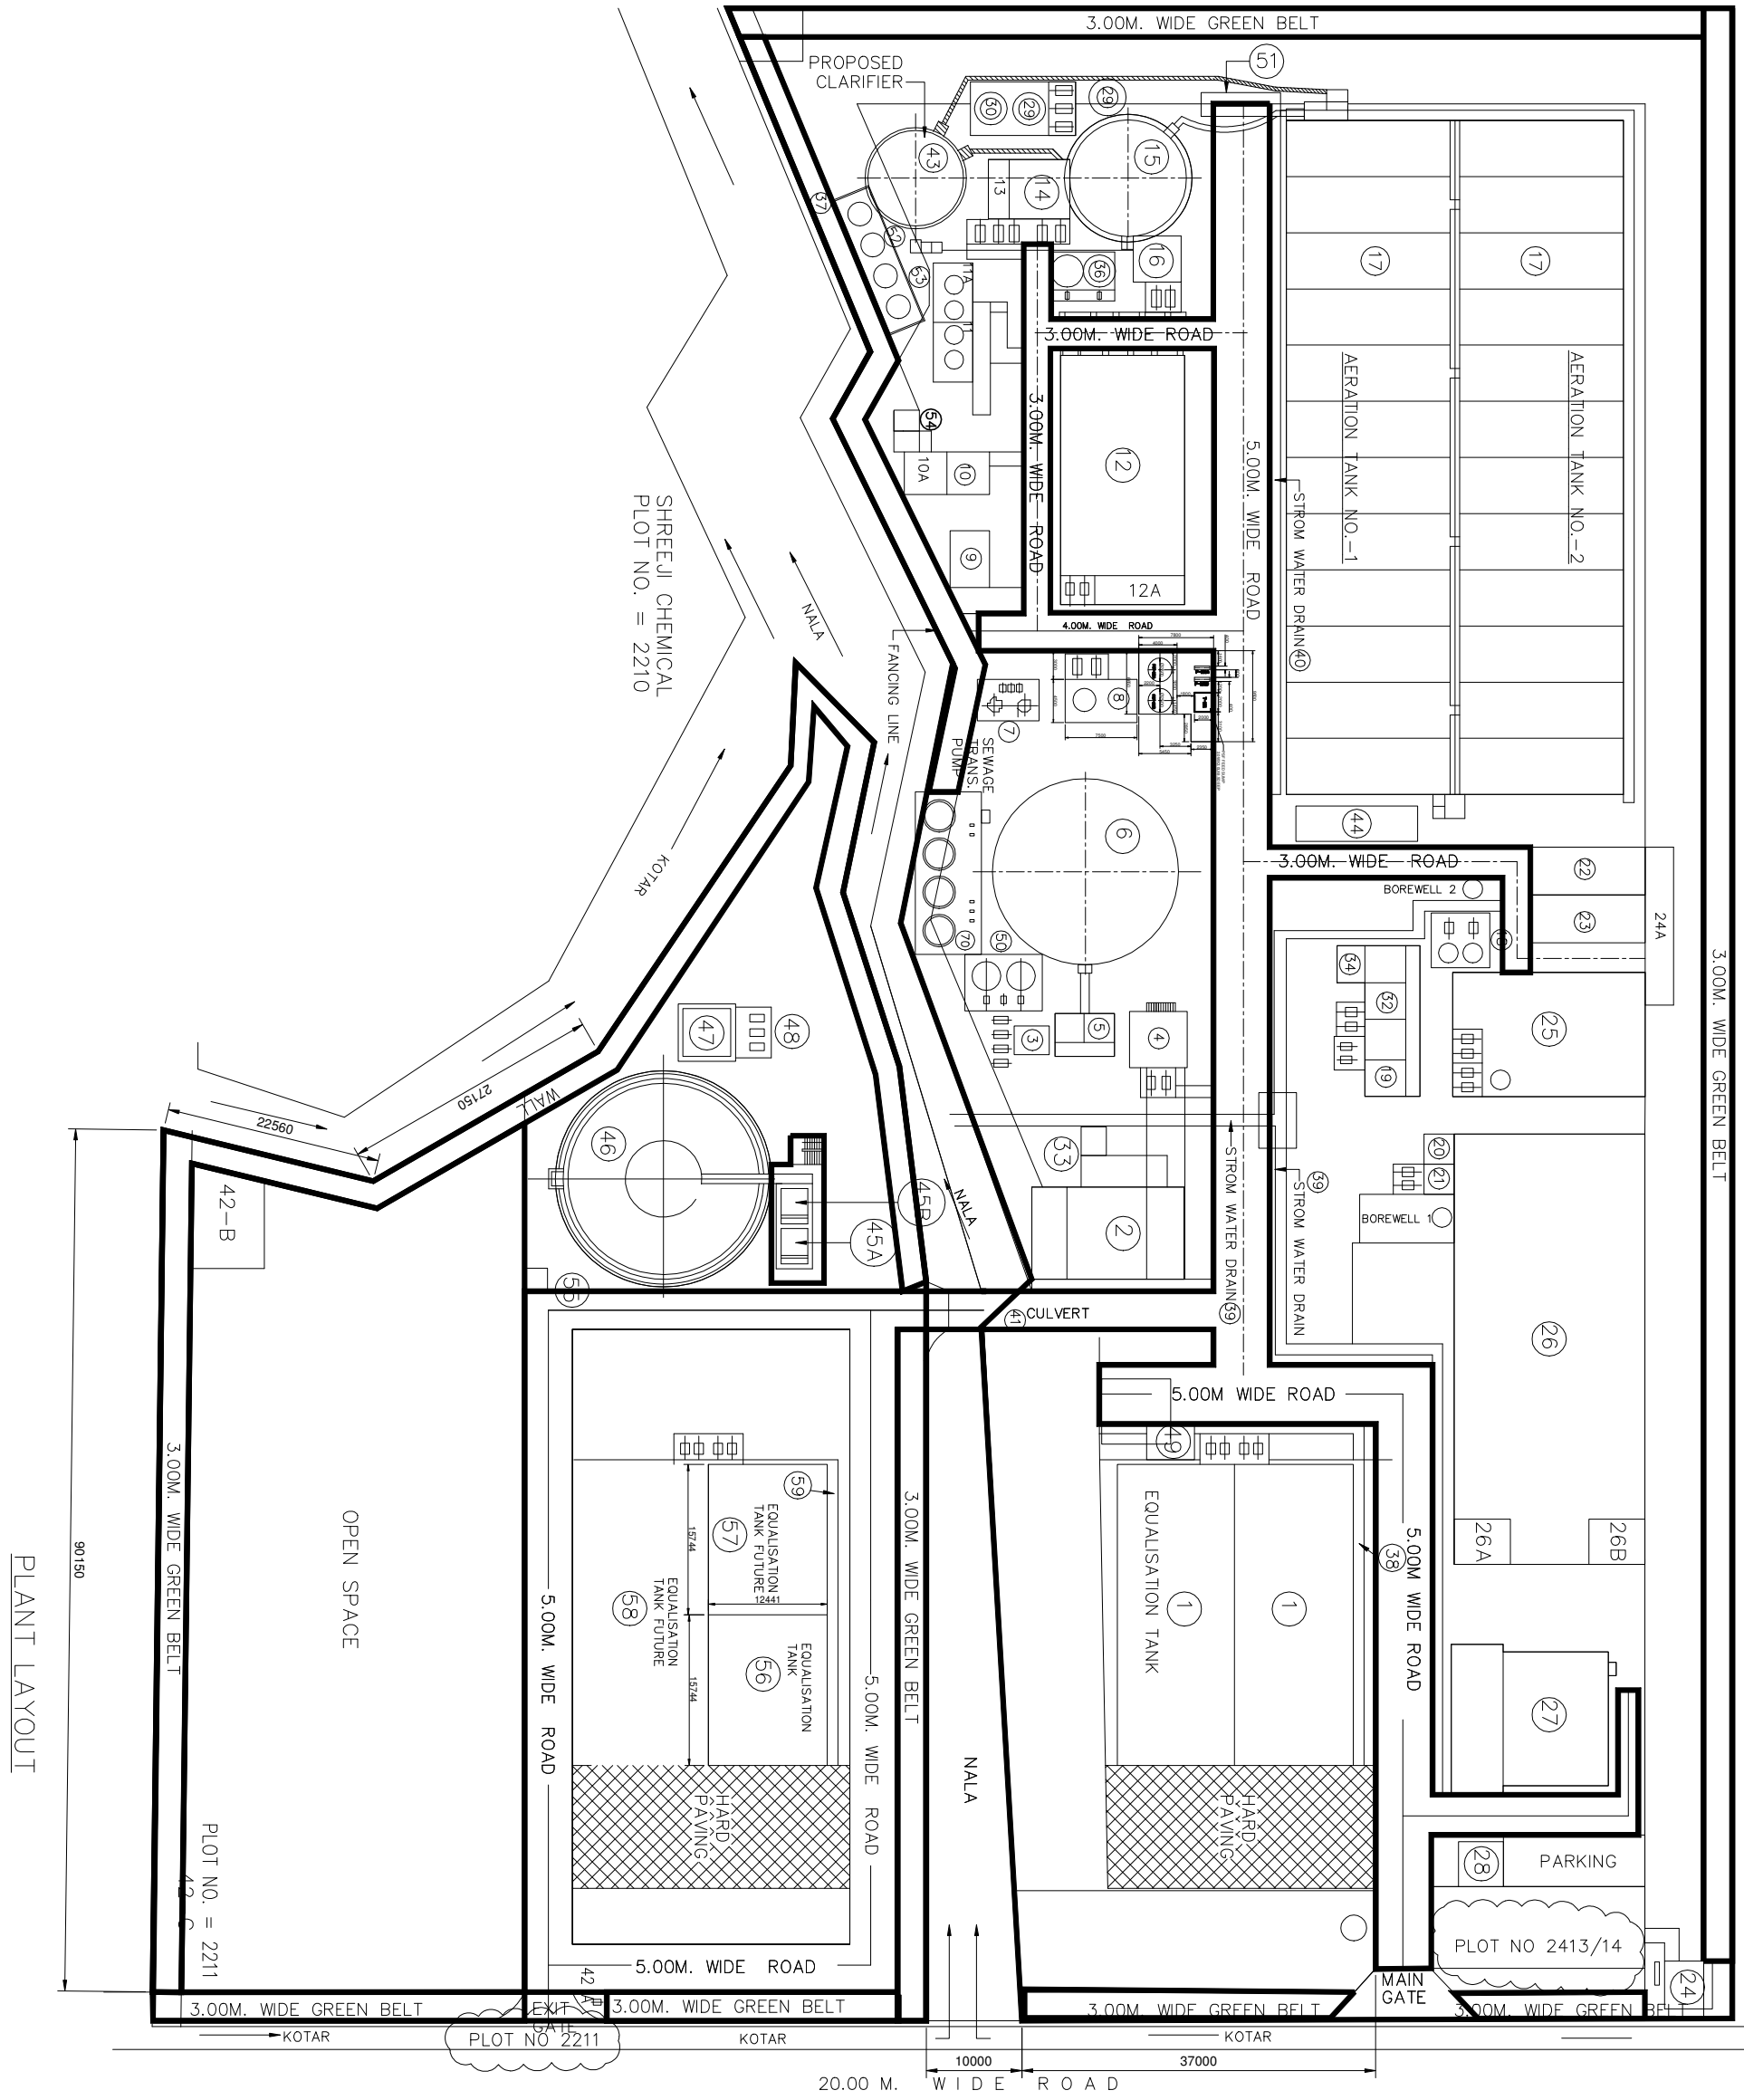
Reviewed & Authorized By:

Mrs. Kamini Prajapati
(Environmental Engineer,
Environmental Testing & Research
Laboratory)

-----END OF THE REPORT-----

NOTE:

1. The results relate only to the samples tested.
2. The report shall not be reproduced except in full, without the written approval of the laboratory.



PLANT LAYOUT

SHREEJI CHEMICAL
PLOT NO. = 2210

PLOT NO. = 2211

PLOT NO 2413/14

20.00 M. WIDE ROAD

90150

22560

27150

42-B

KOTAR

KOTAR

KOTAR

3.00M. WIDE GREEN BELT

3.00M. WIDE GREEN BELT

3.00M. WIDE GREEN BELT

3.00M. WIDE GREEN BELT

3.00M. WIDE GREEN BELT

5.00M. WIDE ROAD

5.00M. WIDE ROAD

5.00M WIDE ROAD

5.00M WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD

3.00M. WIDE ROAD



DG CL

No. DGVCL/Tech-3/BRH/Addl-29/

Dakshin Gujarat Vij Company Ltd.

Nana Varachha Road, Kapodra Char Rasta
SURAT: 395 006.

12583-

Phone No.: 0261 - 2804231

Fax No.: 0261 - 2572636

Email dgvl.gebmail.com

Date:

12583-

"Save Energy for Benefit of Self and Nation"

27 MAR 2006

BY R.P.A.D.

To,

M/s Enviro Technology Limited,

2413 14, GIDC.

ANKLESHWAR - 393 002.

*AGH.
Bl. speak.
B.S.*

Sub: - Release of additional power of 125 KVA to raise your contract demand from 475 KVA to 600 KVA at GIDC, Ankleshwar - HT NO. 39564.

Ref: - (1) Estimate No: DGVCL/TECH-3/BRH/Addl-29/ 11749 Dtd. 27/02/06

(2) Agreement execution Date: - 23/03/06.

Dear Sir,

With reference to the above, this is to inform you that it is agreed to release additional load of 125 KVA during day and night hours in addition to existing load of 475 KVA presently drawn, raising your contract demand from 475 KVA to 600 KVA. Out of total contract demand of 600 KVA you are permitted to utilize 600 KVA only during day and night hours. The above load is released on contingent basis i.e. withdrawable at any time without giving any notice if the power position so warrants. This is subject to power cut in force from time to time.

You may please contact of E.E., Ankleshwar-Ind Dn. who will arrange to release supply as soon as he is ready on his side.

From the date of release of additional power you will be billed on the basis of increased contract demand of 600 KVA on tariff HTP- II A.

Actual power supply shall be released only after furnishing of No Objection Certificate (Not Site Clearance) from Gujarat Pollution Control Board GANDHINAGAR to our field office under intimation to this office, failing which the minimum bill shall commence after expiry of two months from the of issue of this letter, if you fail to avail this power within two months period from the date of this letter, you will be billed for your total contract demand inclusive of this additional load for monthly minimum charges after expiry of two months period from the date of issue of this letter as per provision of tariff as imposed from time to time for your total contract demand of 600 KVA which is inclusive of addl demand of 125 KVA.

Yours faithfully,

ADDL. CHIEF ENGINEER (O&M)

27/03/06



March 5, 2013

Enviro Technology Ltd.
Plot No.2413/2414,
GIDC, Ankleshwar.

Sub : Membership Certificate for Common Solid Waste Disposal Facility.

Dear Sir,

We hereby certify that you have become member for the common Solid/Hazardous waste disposal facility of Bharuch Enviro Infrastructure Ltd., at GIDC, Ankleshwar. You have booked solid waste quantity of **36,000 MT / Year.** Your Membership No. is **Ank/048.**

Thanking you,

Yours faithfully,
For BHARUCH ENVIRO INFRASTRUCTURE LTD.

AUTHORISED SIGNATORY

૪

રવિવાર
૨૩ ઓગસ્ટ, ૨૦૦૯

સ્માચાર ગુજરાતમિત્ર

તથા ગુજરાત સર્વેશ

સાકારક વિભાગ	
સંખ્યા	કિંમત
૧	૨૦૦
૨	૩૦૦
૩	૪૦૦
૪	૫૦૦
૫	૬૦૦
૬	૭૦૦
૭	૮૦૦
૮	૯૦૦
૯	૧૦૦૦
૧૦	૧૨૦૦
૧૧	૧૪૦૦
૧૨	૧૬૦૦
૧૩	૧૮૦૦
૧૪	૨૦૦૦
૧૫	૨૨૦૦
૧૬	૨૪૦૦
૧૭	૨૬૦૦
૧૮	૨૮૦૦
૧૯	૩૦૦૦
૨૦	૩૨૦૦
૨૧	૩૪૦૦
૨૨	૩૬૦૦
૨૩	૩૮૦૦
૨૪	૪૦૦૦
૨૫	૪૨૦૦
૨૬	૪૪૦૦
૨૭	૪૬૦૦
૨૮	૪૮૦૦
૨૯	૫૦૦૦
૩૦	૫૨૦૦
૩૧	૫૪૦૦
૩૨	૫૬૦૦
૩૩	૫૮૦૦
૩૪	૬૦૦૦
૩૫	૬૨૦૦
૩૬	૬૪૦૦
૩૭	૬૬૦૦
૩૮	૬૮૦૦
૩૯	૭૦૦૦
૪૦	૭૨૦૦
૪૧	૭૪૦૦
૪૨	૭૬૦૦
૪૩	૭૮૦૦
૪૪	૮૦૦૦
૪૫	૮૨૦૦
૪૬	૮૪૦૦
૪૭	૮૬૦૦
૪૮	૮૮૦૦
૪૯	૯૦૦૦
૫૦	૯૨૦૦
૫૧	૯૪૦૦
૫૨	૯૬૦૦
૫૩	૯૮૦૦
૫૪	૧૦૦૦૦

જાણીતા ગાયકોના આગામી ગાજી...
 ગાયકોના આગામી ગાજી...
 ગાયકોના આગામી ગાજી...

એનીરો ટેકનોલોજી લી
સીઈઈમી ના પરિવર્તન માટે પંચવર્ષીય ફોર્મ
 આવી અણવવાની અર્થે...
 આવી અણવવાની અર્થે...
 આવી અણવવાની અર્થે...

૨૬ સપ્તાહ સુધી
રાજીવ ગાંધી આર્ય સ્પોર્ટ્સ
સ્પોર્ટ્સ સ્પેસ

This Press Notice is also available on web site www.lenderhome.com.
 This Press Notice is also available on web site www.lenderhome.com.
 This Press Notice is also available on web site www.lenderhome.com.

SUNDAY TIMES OF INDIA, AHMEDABAD
 AUGUST 9, 2009

TIMES CITY

3

Boys play at the newly-inaugurated basketball court at KP College of Commerce in city

All the subscribers Serviced by M/s. Digicable Network India Pvt. Ltd. will be affected.
 Issued by:
Star Dan Media Services Private Limited
 B-65, 1st Floor, Phase-I, Okhla Industrial Area, New Delhi-110 022

Constable gets life for setting wife, kid ablaze

Junagadh: In a 13-year-old case, a fast track court here sentenced a constable to life imprisonment on Friday for setting his wife and five-year old son ablaze for dowry.
 On night of June 22, 1996, accused Parbat Ahir had locked up his wife Hemi Ahir and son Krunal Ahir in bath room and set them ablaze after dousing them with kerosene. After committing the crime at his residence in Police Headquarters near Jaishree theatre in Junagadh, Ahir went to the police station.
 His neighbours alerted the police after noticing smoke billowing out his house.
 Ahir was arrested on the complaint of Hemi's brother Ramesh Punja. SOURCE: SANDESH

ENVIRO TECHNOLOGY LTD
ENVIRONMENTAL CLEARANCE FOR EXPANSION OF CETP
 It is hereby informed that Ministry of Environment and Forests, Government of India, New Delhi has accorded Environmental Clearance for expansion of Common Effluent Treatment Plant of M/s Enviro Technology Ltd, Plot No 2413 / 14 at GIDC Notified Industrial Estate, Ankleshwar - 393 002, District Bharuch, Gujarat, vide letter # 10-2/2008-IA-III dated 23.07.2009 under the provision of EIA notification dated 14th September 2006. Copies of the Clearance letter are available with Gujarat Pollution Control Board, Bharuch & Gandhinagar, and may also be seen at web site of the Ministry of Environment and Forest, at <http://www.envfor.nic.in>
 Date : 07th August 2009
 Sd/-
 General Manager (Works)

Broelectric with effect factor - 33
 Flower Corporation Private Limited
 From April 2, 1986. On March 28, 2009, the Company was incorporated in India under the Companies Act, 1956.
 Faridabad 121 003, Haryana, India
 on page 129 of the Red Herring
 E-mail: companysecretary@nhpc.com

SHARE OF THE ISSUE OF THE DEBENTURE OF THE COMPANY THROUGH THE PUBLIC ISSUE THROUGH THE INDIA ACTING THROUGH THE INSTITUTE

PRICE CAN BE
THE FLOOR PRICE IS MADE FOR A
BID/ISSUE
 An case of revision in the Price exceeding a total of 10 working days through a 100% Book Building through a Running Lead Managers ("RLM") Pursuant to Rule 19(2)(b) of the through a 100% Book Building through a Funds, subject to valid Bids being to the public and the size of the refunded forthwith. Further, up available for allocation on a pro made available for allocation: "and their Equal Bidders the following is sub-accounts registered with the following is added: "Sub-accounts of added: "Sub-accounts of dividend".

Two die in Talaja bridge collapse

Franchise Mart & THE TIMES OF INDIA
 PRESENT
FRANCHISE

Compliance Status for the period of April'23 to September'23 of Environment clearance to M/s Enviro Technology Limited for proposed expansion with modification of existing Common Effluent Treatment Plant at Ankleshwar within the existing premises at plot no 2413/14, Notified G.I.D.C. Estate, Ankleshwar. In category B- 7(h) of schedule with EIA notification, 2006.

Note: We have received NOC on dated 22.04.2020 but due to Pandemic Covid-19, the project was delayed. Currently construction work for the said project is completed and plant is ready for commissioning. (From 1.8 MLD to 3.5 MLD industrial effluent)

Environmental Clearance No. 10-82/2018-IA-III dated 16th December 2019

1. This has reference to your online proposal No. INGJ/MIS/84597/2018 dated 9th April 2019, submitted to this Ministry for grant of Environmental Clearance (EC) in terms of the provisions of the Environment Impact Assessment (EIA) Notification, 2006 under the Environment (Protection) Act, 1986.:

Noted

2. The proposal for grant of environmental clearance to the project Proposed expansion with modification of existing Common Effluent Treatment Plant at Ankleshwar within the existing premises by M/s Enviro Technology Limited, was considered by the Expert Appraisal Committee (Infra-2) in its 41st meeting held during 27-29 May, 2019 and 42nd meeting held during 10-12 July, 2019. The details of the project, as per the documents submitted by the project proponent, and also as informed during the above meeting are as under:

- (i) M/s Enviro Technology Ltd. is the operator of existing CETP (capacity 2.2 MLD effluent with sewage of 1.7 MLD), since 1996 at plot No 2413/14 GIDC Notified Industrial Estate Ankleshwar. Raw Effluent from more than 250-member industries such as dyes, intermediate, pigment, chemicals, textile, pharmaceuticals etc. that are flourishing in and around Ankleshwar industrial estate is collected in tankers and treated at CETP having Primary, Secondary and Tertiary Treatment facilities. Treated effluent from CETP is being discharged through GIDC drain into Final Effluent Treatment Plant (FETP) operated by M/s. Narmada Clean Technology Ltd. (NCT), Ankleshwar for further treatment and disposal to deep sea. The plant is in operation with valid Consent to Operate & Authorization valid up to 18.03.2024.:

Noted

- (ii) The Enviro Technology Limited had obtained Environment Clearance (EC) vide letter No.10 2/2008-IA.III dated 23.07.2009 for proposed capacity enhancement of Common Effluent Treatment Plant (CETP) for treatment of industrial effluent from 1.8 to 3.5 MLD. The Validity of Environmental Clearance (EC) for expansion was extended up to 22.07.2019 vide Letter No 10-2/2008-IA. III dated 03.07.2017 for treatment of 3500 m³/day industrial wastewaters and use of 1445 m³/day GIDC water. Consequent to notification of Moratorium imposed on Critically Polluted Areas which included Ankleshwar Industrial Estate vide OM No. J-11013/5/2010-IA. 11 (1) on 13.01.2010, there has been no expansion and no new industries came up as a result there has been no increase in effluent quantity. Accordingly, ETL did not expand the capacity of CETP and continued to operate on existing capacity of 2.2 MLD of raw effluent as earlier. In the year 2016, the Moratorium has been lifted for Ankleshwar Vide Letter No. J-11013/5/2010-1A. II (A) dated 25.11.2016 based on CEPI index.:

Noted

- (iii) M/s ETL proposes expansion from 1.8 to 3.5 MLD industrial effluent with modification in the treatment technology plans to utilize the modified quantity sewage mixed with industrial wastewater and fresh water used for chemical dosing & other uses as detailed below:

Sr. No.	Particular	Existing (MLD)	Proposed (MLD)
1.	Industrial Effluent from Member Industries (including 600 m ³ /day of effluent stream of high Ammoniacal Nitrogen)	1.8	3.5
2.	Sewage	1.7	1.7
3.	Fresh/Raw Water	0.725	0.465
4.	Quantity of discharge of Effluent from CETP	3.5	5.548

Noted

- (iv) Treated effluent from ETL is discharged to GIDC Drainage system which goes to FETP of NCTL (Narmada Clean Technology Ltd) along with effluent from other industries, for further treatment and disposal up to deep sea through closed pipeline system. ETL has also obtained membership for discharge of additional quantity of effluent after proposed expansion:

Noted

- (v) The hazardous wastes generated from different process are listed below & shall be disposed according to Hazardous waste management handling rule.

Hazardous Waste / quantity per year	Source	Mode of disposal
ETP Sludge/36500 MT	ETP	BEIL, TSDF site
Used oil/1.8 MT	lubrication of equipment, DG set	Sold to approved recycler
Discarded Container/ 730 Nos.	Raw material packing container	Sold to authorized dealers
Spent Carbon from Tertiary Treatment / 54 MT	Filters	BEIL, TSDF site

Noted

- (vi) As per the EIA Notification, 2006 [as amended], the Common Effluent Treatment Units (CETP) units listed at Serial no. 7 (h) of the Schedule of EIA Notification of categorized under Category However due to location of the existing CETP in the Critically Polluted Area the project has been categorized as "A" category.:

Noted

- (vii) Salient Features of the Project are:

Sr.no.	Parameters	Description
1.	Proposed plant capacity	Industrial wastewater: 3500 m ³ /day (including 600 m ³ /day of effluent stream of high ammonical nitrogen). Sewage: 1700 m ³ /day Raw water: 465 m ³ /day Total Influent: 5625 m ³ /day Total Discharge: 5548 m ³ /day
2.	Existing plant capacity	Effluent: 1800 m ³ /day Sewage: 1700 m ³ /day Raw water: 725 m ³ /day Total Discharge: 3500 m ³ /day (as per valid consent of GPCB)
3.	Plot Area	26543.79 sqm
4.	Location	Notified Industrial Area, Ankleshwar, Gujarat
	Coordinates	Latitude: 21037'11.03''N Longitude: 730 01'38.52'' E
5.	Source of Water	GIDC water supply
6.	Electricity /Power requirement	600 KVA Existing & 600 KVA Proposed. In case of power failure D.G. Set (2*1010 KVA Capacity) will be used.

Noted

- (viii) ToR was approved by MoEF & CC (EAC), New Delhi vide letter F.No. 10 82/2018-IA- III dated 13.12.2018.:

Noted

- (ix) Baseline monitoring of UPL-1 is also collected by us during from 8th March 2018 to 3rd June,2018 and same was revalidated for one month during 17th December 2018 to 15th January 2019.:

Noted

- (x) Public hearing was exempted as the project area falls under notified Industrial zone of Ankleshwar.:

Noted

(xi) Investment Cost of the project is approx. Rs. 19.35 Crores.:

Noted

(xii) Benefits of the project: The proposed CETP shall help in the economical treatment of industrial effluent from small scale industries. Thereby, improving the surrounding environment. Increase in direct/indirect employment opportunities thereby improving overall socio-economic condition.:

Noted

(xiii) Employment potential: During operation phase, total no of employee would be around 50.:

Noted

3. The project/activity is covered under category 'B' of item 7 ('Common Effluent Treatment plants (CETPs)' of the Schedule to the EIA Notification, 2006 and its subsequent amendments, and requires appraisal at State level. However, due to applicability of general condition i.e. project location in Critically Polluted Area, Ankleshwar, the proposal has been appraised at Central Level.:

Noted

4. The proposal was considered by EAC (Infra-2) in its 41st meeting held during 27-29 May 2019 and 42nd meeting held during 10-12 July 2019. The EAC during its meeting deliberated on the certified compliance report letter No. 5-283/2009(ENV)/161 dated 7.3.2019 issued by the MoEF&CC Regional Office Bhopal. As per Compliance report out of total 32 conditions, 7 are fully complied, 02 are compiled subject to condition, 4 are in which compliance are not applicable to the project proponent, 15 are agreed to comply and 4 are noted. As per the compliance report, the project proponent i.e. M/s Enviro Technology Limited had received 12 show-cause notices and 02 Directions for closure in past 3 years. All of which have been complied. No closure notice received in the past three years.:

Noted

5. The EAC, based on the information submitted and clarifications provided by the Project Proponent and detailed discussions held on all the issues, recommended for grant of Environmental Clearance to the project with stipulated specific conditions along with other Standard EC Conditions as specified by the Ministry vide OM dated 4th January 2019 for the said project/activity, while considering for accord of environmental clearance. As per recommendations of the EAC, the Ministry of Environment, Forest and Climate Change hereby accords Environmental Clearance to the project Proposed expansion with modification of existing Common Effluent Treatment Plant at Ankleshwar within the existing premises by M/s Enviro Technology Limited, under the provisions of the EIA Notification, 2006 and amendments/circulars issued thereon, and subject to the specific and general conditions as under: -

Noted

A. SPECIFIC CONDITION:

Sr. No	Description	Status
I.	The project proponents will implement the project only after getting consent to establish from the SPCB.	Complied We have received CTE from SPCB on 22.04.20, but due to Pandemic Covid -19, we have not implemented the project. We had Completed Our Construction Work.
II	It shall be ensured that primary treatment of effluents to the level of influent quality standards as prescribed by the board, is ascertained at the member units.	Shall be Complied We are complying the same for existing operation (i.e. 2.2 MLD industrial effluent) and will comply the same after implementation of 3.5 MLD industrial effluent project.
III.	Member shall only be allowed access to the CETP if they have consent from the SPCB.	Shall be Complied. We are complying the same for existing operation (i.e. 2.2 MLD industrial effluent) and will comply the same after implementation of 3.5 MLD industrial effluent project.
IV.	A dedicated access-controlled conveyance system shall be provided for transporting effluents from the member units of CETP.	Shall be Complied Conveyance of effluent is through dedicated tankers controlled by ETL. This system is followed presently, and we shall ensure compliance after project implementation.
V.	Conformance to the influent and effluent standards shall be the responsibilities of CETP.	Shall be Complied We are complying the same for existing operation (i.e. 2.2 MLD industrial effluent) and will comply the same after implementation of the project.
VI.	The design of the CETP should be as approved by PCB.	Complied We have submitted the layout and details to GPCB when taking CTE.
VII.	There shall be flow meters at inlet and outlet of CETP to monitor the flow. Suitable meters shall be provided to measure the quantity of effluent received, quantity of effluent recycled/reused and discharged.	Shall be Complied Reused Water is used in Guard Pond in Bioaugmentation and for Backwash of Sand filter and the quantity is approx. 200-250 m ³ /month. Effluent is received in tankers and the details are maintained. At outlet, we have a flow meter installed and readings noted. Based on this the quantities of inlet and outlet are measured. Same system or other adequate system shall be adopted on implementation of the project. Details of effluent received, and effluent discharged currently are attached below.

		Month	Average Inlet Effluent (MLD) (2.2 MLD Industrial Effluent)	Final Discharge Quantity Along with 1.1 MLD sewage (Avg. MLD)																																																								
		April-23	1.398	2.122																																																								
		May-23	1.369	2.016																																																								
		June-23	1.432	2.424																																																								
		July-23	1.553	2.684																																																								
		August-23	1.560	2.331																																																								
		September-23	1.585	2.678																																																								
VIII.	The units and the CETP shall maintain daily logbook of the quantity and quality of discharge from units, quantity of inflow into the CETP, details of the treatment at each stage of the CETP including the raw materials used, quantity of the treatment water sent back to the units, quantity of the salts extracted from the treatment process and detail of the selling of such salts. All the above information shall be provided on the line of the website exclusive prepared from the purpose by the CETP owner. The website shall be accessible by the public. The financial and energy details of the CETP will also be provided along with details of the workers of the CETP	<p>Shall be Complied</p> <p>For existing operation of 2.2 MLD, ETL is maintaining details for the following</p> <ul style="list-style-type: none"> - quantity and quality of discharge of Effluent - Record of Inflow to CETP - Details of treatment at each stage - Record of raw materials used. <p>It may be noted that ETL is not sending back treated water to member units and is also not extracting salt.</p> <p>EC compliance report comprising the above information is uploaded on the website.</p> <p>We will also follow the same for proposed expanded capacity.</p> <p>We are having digital display board in front of CETP and all the required details are displayed.</p>																																																										
IX.	Periodical monitoring shall be carried out for the functioning of CETP and outlet parameters.	<p>Shall be Complied</p> <p>For the existing system of 2.2 MLD effluent:</p> <ol style="list-style-type: none"> a) Effluent characteristic at each stage of CETP are regularly monitored to ensure proper functioning of the CETP. b) Outlet parameters are also monitored regularly in-house and by a third party monthly. <table border="1" style="width: 100%; text-align: center;"> <thead> <tr> <th colspan="8">Average of Final Discharge Quality for 2.2 MLD</th> </tr> <tr> <th>Month</th> <th>Apr.-23</th> <th>May-23</th> <th>June-23</th> <th>July-23</th> <th>Aug.-23</th> <th>Sep.-23</th> <th>GPCB Permissible Limits</th> </tr> </thead> <tbody> <tr> <td>pH</td> <td>7.76</td> <td>7.54</td> <td>7.66</td> <td>7.56</td> <td>7.53</td> <td>7.48</td> <td>6.5 to 8.5</td> </tr> <tr> <td>COD</td> <td>884</td> <td>865.07</td> <td>842</td> <td>661</td> <td>804.31</td> <td>835.07</td> <td>1000 mg/L</td> </tr> <tr> <td>BOD</td> <td>6.90</td> <td>4.88</td> <td>6.33</td> <td>5</td> <td>7.38</td> <td>8.27</td> <td>200 mg/L</td> </tr> <tr> <td>TSS</td> <td>45.28</td> <td>44.90</td> <td>44.60</td> <td>47.81</td> <td>47.71</td> <td>59.33</td> <td>150 mg/L</td> </tr> <tr> <td>NH4-N</td> <td>64.40</td> <td>36.90</td> <td>41.10</td> <td>48.26</td> <td>43.06</td> <td>37.53</td> <td>50 mg/L</td> </tr> </tbody> </table>			Average of Final Discharge Quality for 2.2 MLD								Month	Apr.-23	May-23	June-23	July-23	Aug.-23	Sep.-23	GPCB Permissible Limits	pH	7.76	7.54	7.66	7.56	7.53	7.48	6.5 to 8.5	COD	884	865.07	842	661	804.31	835.07	1000 mg/L	BOD	6.90	4.88	6.33	5	7.38	8.27	200 mg/L	TSS	45.28	44.90	44.60	47.81	47.71	59.33	150 mg/L	NH4-N	64.40	36.90	41.10	48.26	43.06	37.53	50 mg/L
Average of Final Discharge Quality for 2.2 MLD																																																												
Month	Apr.-23	May-23	June-23	July-23	Aug.-23	Sep.-23	GPCB Permissible Limits																																																					
pH	7.76	7.54	7.66	7.56	7.53	7.48	6.5 to 8.5																																																					
COD	884	865.07	842	661	804.31	835.07	1000 mg/L																																																					
BOD	6.90	4.88	6.33	5	7.38	8.27	200 mg/L																																																					
TSS	45.28	44.90	44.60	47.81	47.71	59.33	150 mg/L																																																					
NH4-N	64.40	36.90	41.10	48.26	43.06	37.53	50 mg/L																																																					

		<p>“Monthly third-party monitoring data for 2.2 MLD effluent”</p> <p>Internal monitoring & third-party monitoring shall be carried out on implementation of the project.</p> <p>Third party monitoring reports for existing system are attached as Annexure – 1(A).</p>
X.	The MOU between CETP and member units shall indicate the maximum quantity of effluent to be sent to the CETP along with the quality.	<p>Shall be Complied</p> <p>This procedure is being followed for the existing system and shall be complied in the future also.</p>
XI.	Individual members to the CETP shall treat their effluents in primary treatment systems to the inlet quality standards of the CETP as prescribed by the SPCB.	Member industries are giving primary treatment.
XII.	Individual members shall segregate their wastes in to concentrated and diluted streams and also as per the nature of chemical contamination and store them as per conditions to be specifically imposed in this regard by the SPCB.	Segregation of effluent is done by industries. High Ammonia streams are sent separately for MAP treatment & remaining effluent is treated in the General Treatment section.
XIII.	Chemical recovery and reuse, either in-house or outside shall be practiced to the satisfaction of the SPCB. Use in agriculture shall be exercised with caution after getting the irrigation management plan approved by the SPCB.	Noted
XIV.	All tankers carrying untreated wastes and all hazardous and other wastes shall be properly labeled and transported as per the hazardous and other wastes rules 2016.	<p>Shall be Complied</p> <p>We are complying the same for existing operation (i.e. 2.2 MLD industrial effluent) and will comply the same after implementation of expansion.</p>
XV.	The detailed design of the various unit operation shall strictly conform to the directions of the SPCB as given in the CTE.	Shall be Complied
XVI.	<p>The project proponent and SPCB should ensure that the member ship of CETP is restricted to only those industries which legitimately exist in the area. A list of industries in this regard shall be prepared by the association which will have the following details.</p> <ul style="list-style-type: none"> ● Name of industry ● Office address ● Location of industry 	<p>Complied</p> <p>Before giving membership to any industry, we take their CTE issued by GPCB.</p>

	<ul style="list-style-type: none"> • Status of consent under water act along with order number. • Status of consent under air act along with order number. • Production capacity as per consent orders. <p>Total industrial effluent to CETP as per consent order.</p>	
XVII	The unit shall inform the SPCB at least a week prior to undertaking maintenance activities in the recycle system and store/dispose treated effluents under their advice in the matter.	<p>Shall be Complied.</p> <p>We are complying the same for existing operation (i.e., 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.</p>
XVIII	The unit shall also immediately inform the PCB of any breakdown in the recycling system, store the effluents in the interim period and dispose effluents only as advised by the PCB.	<p>Shall be Complied</p> <p>We are complying the same for existing operation (i.e. 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.</p>
XIX	The unit shall maintain a robust system of conveyance for primary treated effluents from the member units and constantly monitor the influent quality to the CETP. The management of the CETP and the individual member shall be jointly and severally responsible for conveyance and pretreatment of effluents. Only those units will be authorized to send their effluents to the CETP which have a valid consent of the PCB and which meet the primary treated standards as prescribed. The CETP operator shall with the consent of the SPCB retain the powers to delink the defaulter unit from entering the conveyance system.	<p>Shall be Complied</p> <p>The effluent is conveyed to CETP through dedicated tankers of CETP. We are complying the same for existing operation (i.e., 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.</p>
XX	The CETP operator will maintain an annual register of member units which will contain the details of products with installed capacities and quality of effluents accepted for discharge. This will form a part of the initial and renewal applications for CTO to be made before the SPCB.	Noted
XXI	Any changes in the manufacturing process, installed capacity or the quality or quantity of effluents as agreed upon in the initial MOU between the operator and	Noted and Shall be Complied.

	the member units, will only be done after an approval of the SPCB.	MOU between the ETL(CETP) and the member units will be done. In MOU, details of manufacturing Process, installed capacity are described. We are complying the same for existing operation (i.e. 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.																
XXII	The treated effluent from CETP shall be blended with treated sewage prior to its discharge in river.	Not Applicable In our existing as well as proposed system for 3.5 MLD effluent, sewage is mixed with effluent before the effluent enters biological (secondary) treatment process. The treated effluent is not blended with treated sewage. Also, our discharge is to FETP for further treatment and not in river.																
XXIII	Domestic water requirement is 0.675 KLD, which will be met through water tanker supply.	Shall be Complied We are complying the same for existing operation (i.e. 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project. We are getting water from GIDC through pipeline. In case of non-availability of water from GIDC, water from borewell is drawn. NOC from CGWA for withdrawal of ground water is received.																
XXIV	The quantity of hazardous waste i.e. ETP sludge to be generated from CETP facility shall be handled and disposed to nearby authorized TSDF site as per HWM Rules, 2016.	Shall be Complied Unit is disposing sludge to Common TSDF –BEIL for their existing operation and will continue the same for proposed operation after implementation. Sludge disposal quantity for existing facility is given under: (April’23 to September’23). Noted for compliance as the 1.8 to 3.5 MLD effluent project is not yet implemented. <table border="1" data-bbox="774 1406 1489 1736"> <thead> <tr> <th>Month</th> <th>Sludge Quantity (MT)</th> <th>Consented Qty. in MT/Year</th> </tr> </thead> <tbody> <tr> <td>April-23</td> <td>204.55</td> <td rowspan="6">36500</td> </tr> <tr> <td>May-23</td> <td>224.32</td> </tr> <tr> <td>June-23</td> <td>272.20</td> </tr> <tr> <td>July-23</td> <td>247.23</td> </tr> <tr> <td>August-23</td> <td>299.44</td> </tr> <tr> <td>September-23</td> <td>295.27</td> </tr> </tbody> </table> Membership certificate of BEIL to dispose sludge is attached as Annexure -1(B)	Month	Sludge Quantity (MT)	Consented Qty. in MT/Year	April-23	204.55	36500	May-23	224.32	June-23	272.20	July-23	247.23	August-23	299.44	September-23	295.27
Month	Sludge Quantity (MT)	Consented Qty. in MT/Year																
April-23	204.55	36500																
May-23	224.32																	
June-23	272.20																	
July-23	247.23																	
August-23	299.44																	
September-23	295.27																	
XXV	Non-hazardous solid wastes and sludges arising out of the operation of the CETP shall be adequately disposed as per the consent to be availed from the SPCB.	Complied We are complying the same for existing operation (i.e., 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.																

	Non-hazardous solid wastes and sludges shall not be mixed with hazardous waste.																													
XXVI	The effluent from member units shall be transported through pipeline. In case the effluent is transported through road, it shall be transported through CETP tankers only duly maintaining proper manifest system. The vehicle shall be fitted with proper GPS system.	<p>Shall be Complied</p> <p>Currently also the effluent is transported through road by CETP tankers fitted with GPS and proper manifest system.</p>																												
XXVII	Before accepting any effluent from member units, the same shall be as permitted by the SPCB in the consent order. No effluent from any unit shall be accepted without consent from SPCB under the water Act, 1974 as amended.	<p>Shall be Complied</p> <p>We are complying the same for existing operation (i.e., 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.</p>																												
XXVIII	The CETP shall have adequate power back up facility, to meet the energy requirement in case of power failure from the grid.	<p>Shall be Complied</p> <p>For existing operation, as power back up, ETL has installed DG Set of 1010 KVA for smooth operation during power failure. After implementation of the project an additional DG set of 1010 KVA shall be installed to meet the energy requirement in case of power failure.</p>																												
XXIX	All the recommendation of the EMP shall be complied with letter and spirit. All the mitigation measures submitted in the EIA report shall be prepared in a matrix format and the compliance for each mitigation plan shall be submitted to RO, MOEF and CC along with half yearly compliance report.	<p>Shall be Complied.</p> <p>Environment Audit Report and Compliance status are submitted to RO, MOEF&CC along with half yearly report.</p>																												
XXX	The project proponent shall set up separate environmental management cell for effective implementation of the stipulated environment safeguards under the supervision of a senior executive.	<p>Complied</p> <p>Details are as under:</p> <table border="1"> <thead> <tr> <th>Sr. No</th> <th>Name of the employee</th> <th>Designation</th> <th>Educational Qualification</th> </tr> </thead> <tbody> <tr> <td>1.</td> <td>Mr. B. D. Dalwadi</td> <td>C.E.O.</td> <td>B.E. Chemical</td> </tr> <tr> <td>2.</td> <td>Mr. A. M. Darji</td> <td>Unit Head</td> <td>M.Sc.- Biochemistry, LL.B</td> </tr> <tr> <td>3.</td> <td>Mr. Narendra B Patel</td> <td>D.G.M</td> <td>M. Sc & PG Dip in Env. Mgt. & Tech.</td> </tr> <tr> <td>4.</td> <td>Mr. Akhil P. Karkhanis</td> <td>Unit Head</td> <td>M.E. Chemical</td> </tr> <tr> <td>5.</td> <td>Ms. Rakshita Vyas</td> <td>Sr. Manager (Env.)</td> <td>M.Sc. Environment</td> </tr> <tr> <td>6.</td> <td>Ms. Priya Patel</td> <td>Officer (Env.)</td> <td>B.E. Environment</td> </tr> </tbody> </table>	Sr. No	Name of the employee	Designation	Educational Qualification	1.	Mr. B. D. Dalwadi	C.E.O.	B.E. Chemical	2.	Mr. A. M. Darji	Unit Head	M.Sc.- Biochemistry, LL.B	3.	Mr. Narendra B Patel	D.G.M	M. Sc & PG Dip in Env. Mgt. & Tech.	4.	Mr. Akhil P. Karkhanis	Unit Head	M.E. Chemical	5.	Ms. Rakshita Vyas	Sr. Manager (Env.)	M.Sc. Environment	6.	Ms. Priya Patel	Officer (Env.)	B.E. Environment
Sr. No	Name of the employee	Designation	Educational Qualification																											
1.	Mr. B. D. Dalwadi	C.E.O.	B.E. Chemical																											
2.	Mr. A. M. Darji	Unit Head	M.Sc.- Biochemistry, LL.B																											
3.	Mr. Narendra B Patel	D.G.M	M. Sc & PG Dip in Env. Mgt. & Tech.																											
4.	Mr. Akhil P. Karkhanis	Unit Head	M.E. Chemical																											
5.	Ms. Rakshita Vyas	Sr. Manager (Env.)	M.Sc. Environment																											
6.	Ms. Priya Patel	Officer (Env.)	B.E. Environment																											

XXXI	The funds earmarked for environment management plan shall be included in the budget and this shall not be diverted for any other purposes.	Noted Approximately 2.0 lakhs at construction stage & 2.80 lakhs /annum at operational stage. Our unit is a CETP and hence all the expenditure is for the purpose of environment protection measures.
XXXII	Project proponent should develop green belt all along the periphery of the site with native plant species that are significant and used for the pollution abatement.	Complied There is no addition of land for the proposed expansion.
XXXIII	The company shall draw up and implement corporate social responsibility plan as per the company act of 2013.	Shall be Complied For the existing system, the company performs CSR as per the company act and after implementation of the project also the same shall be continued.
XXXIV	As per the ministry's office memorandum F No. 22-65/2017-IA.III dated 1 st May 2018, and proposed by the project proponent, an amount of Rs. 19.35 Lakhs @ 1.0% of project cost shall be earmarked under corporate environment responsibility for the activities such as health, education, employability, and environment etc. the activities proposed under CER shall be restricted to the affected area around the project. The entire activities proposed under the CER shall be treated as project and shall be monitored. The monitoring report shall be submitted to the RO as a part of half yearly compliance report, and to the district collector. It should be posted on the website of the project proponent.	Shall be complied.
XXXV	The project proponent shall also comply with the mechanism prescribed by the ministry vide letter No. Q*-16017/38/2018-CPA dated 24.10.2019 and O.M. F. No.22-23/2018-IA.III(pt.) dated 31.10.2019 for the instant project.	Noted

B. STANDARD CONDITION:
Statutory compliance:

I.	The project proponent shall obtain forest clearance under the provisions of forest act,1980, in case of the diversion of forest land for non-forest purpose involved in the project.	Not Applicable
II.	The project proponent shall obtain clearance from the national board for wildlife, if applicable.	Not Applicable
III.	The project proponent shall prepare a site-specific conservation plan and wildlife management plan and approved by the chief wildlife warden. The recommendations of the approved site-specific conservation plan/wildlife management plan shall be implemented in consultation with the state forest department. The implementation report shall be furnished along with the six-monthly compliance report.	Not Applicable
IV.	The project proponent shall obtain CTE/CTO under the provision of air act,1981 and the water act,1974 from the concerned SPCB.	Shall be complied. We have obtained CTE from GPCB. CTO shall be obtained on implementation of the project.
V.	The project proponent shall obtain the necessary permission from the central ground water authority, in case of drawl of ground water/from the competent authority concerned in case of drawl of surface water required for the project.	Shall be complied. Currently, no ground water is utilized at site, water supply is from GIDC Notified Area Authority. Ground water is utilized only when GIDC cannot supply required water.
VI.	A certificate of adequacy of available power from the agency supplying power to the project along with the load allowed for the project should be obtained.	Shall be complied. Power certificate for existing facility obtained and for proposed project, we shall obtain it. Existing Certificate attached as Annexure-1(C)
VII.	All other statutory clearances such as the approvals for storage of diesel from	Not applicable

	chief controller of explosives, fire department, etc. shall be obtained, as applicable by project proponent from the respective competent authority.	No such clearances are required for our CETP, but if required in future, it shall be obtained.
--	--	--

I. Air quality monitoring and preservation:

I	The gaseous emission from DG set shall be dispersed through adequate stack height as per CPCB standards. Diesel generating sets shall be installed, in the downwind direction.	Complied
II	Appropriate air pollution control system shall be provided for fugitive dust from all vulnerable sources, so as to comply prescribed standards.	Noted

II. Water quality monitoring and preservation:

I	The project proponent shall install 24*7 continuous effluent monitoring system with respect to standards prescribed in environment rules 1986 as amended from time to time and connected to SPCB and CPCB online server and calibrate these system from time to time according to equipment supplier specification through labs recognized under environment act,1986 or NABL accredited laboratories.	<p>Shall be complied.</p> <p>We are complying the same for existing operation (i.e. 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.</p>
II	Total freshwater use shall not exceed the proposed requirement as provided in the project details. Prior permission from competent authority shall be obtained for use of fresh water.	<p>Shall be complied.</p> <p>We are complying the same for existing operation (i.e. 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.</p>
III	There shall be flow meters at inlet and outlet of CETP to monitor the flow. Suitable meters shall be provided to measure the quantity of effluent received. Quantity of effluent recycled/reused and discharged.	<p>Complied</p> <p>Effluent is brought to CETP through tankers and these data are maintained. Flow meter is installed at the outlet.</p> <p>Details of effluent received in tankers and effluent discharged are attached below.</p> <p>Same system shall be followed after implementation of proposed project.</p>

		<table border="1"> <thead> <tr> <th>Month</th> <th>Average Inlet Effluent (MLD) (2.2 MLD Industrial Effluent)</th> <th>Final Discharge Quantity Along with 1.1 MLD sewage (Avg. MLD)</th> </tr> </thead> <tbody> <tr> <td>April-23</td> <td>1.398</td> <td>2.122</td> </tr> <tr> <td>May-23</td> <td>1.369</td> <td>2.016</td> </tr> <tr> <td>June-23</td> <td>1.432</td> <td>2.424</td> </tr> <tr> <td>July-23</td> <td>1.553</td> <td>2.684</td> </tr> <tr> <td>August-23</td> <td>1.560</td> <td>2.331</td> </tr> <tr> <td>September-23</td> <td>1.585</td> <td>2.678</td> </tr> </tbody> </table>	Month	Average Inlet Effluent (MLD) (2.2 MLD Industrial Effluent)	Final Discharge Quantity Along with 1.1 MLD sewage (Avg. MLD)	April-23	1.398	2.122	May-23	1.369	2.016	June-23	1.432	2.424	July-23	1.553	2.684	August-23	1.560	2.331	September-23	1.585	2.678																																																								
Month	Average Inlet Effluent (MLD) (2.2 MLD Industrial Effluent)	Final Discharge Quantity Along with 1.1 MLD sewage (Avg. MLD)																																																																													
April-23	1.398	2.122																																																																													
May-23	1.369	2.016																																																																													
June-23	1.432	2.424																																																																													
July-23	1.553	2.684																																																																													
August-23	1.560	2.331																																																																													
September-23	1.585	2.678																																																																													
IV	<p>The units and the CETP will maintain daily logbook of the quantity of discharge from the units. Quantity of inflow into the CETP. Details of the treatment at each stage of the CETP including the raw materials used, quantity of the treated water proposed to be recycled, reuse within the industrial units, quantity of the treated effluent discharged. All the above information shall be provided on-line of the web site exclusively prepared for the purpose by the CETP owner. The website shall be accessible by the public. The financial and energy details of the CETP will also be provided along with details of the workers of the CETP.</p>	<p>Shall be complied.</p> <p>These data are maintained for the existing system and shall be maintained for the 3.5 MLD system. Details of effluent received, and effluent discharged are attached below.</p> <table border="1"> <thead> <tr> <th>Month</th> <th>Average Inlet Effluent (MLD) (2.2 MLD Industrial Effluent)</th> <th>Final Discharge Quantity Along with 1.1 MLD sewage (Avg. MLD)</th> </tr> </thead> <tbody> <tr> <td>April-23</td> <td>1.398</td> <td>2.122</td> </tr> <tr> <td>May-23</td> <td>1.369</td> <td>2.016</td> </tr> <tr> <td>June-23</td> <td>1.432</td> <td>2.424</td> </tr> <tr> <td>July-23</td> <td>1.553</td> <td>2.684</td> </tr> <tr> <td>August-23</td> <td>1.560</td> <td>2.331</td> </tr> <tr> <td>September-23</td> <td>1.585</td> <td>2.678</td> </tr> </tbody> </table> <p>Details of Raw Material consumption (October'2022 to March'2023) in Kgs.</p> <table border="1"> <thead> <tr> <th>Chemicals</th> <th>Apr.-23</th> <th>May-23</th> <th>June-23</th> <th>July-23</th> <th>Aug.-23</th> <th>Sep.-23</th> </tr> </thead> <tbody> <tr> <td>Lime</td> <td>4452 2</td> <td>400 18.6</td> <td>453 56.2</td> <td>446 63.6</td> <td>458 80</td> <td>4539 1.8</td> </tr> <tr> <td>H₂O₂</td> <td>65</td> <td>135</td> <td>0</td> <td>0</td> <td>0</td> <td>0</td> </tr> <tr> <td>FeSO₄ (solid)</td> <td>0</td> <td>0</td> <td>0</td> <td>0</td> <td>0</td> <td>0</td> </tr> <tr> <td>Polyelectrolyte</td> <td>2</td> <td>23</td> <td>4</td> <td>8</td> <td>3</td> <td>6</td> </tr> <tr> <td>De foaming Agent</td> <td>0</td> <td>0</td> <td>0</td> <td>0</td> <td>113</td> <td>67</td> </tr> <tr> <td>Fin Deform-18</td> <td>6050</td> <td>410 0</td> <td>530 0</td> <td>622 0</td> <td>553 0</td> <td>3700</td> </tr> <tr> <td>Phosphoric Acid</td> <td>500</td> <td>750</td> <td>750</td> <td>500</td> <td>770</td> <td>750</td> </tr> </tbody> </table>	Month	Average Inlet Effluent (MLD) (2.2 MLD Industrial Effluent)	Final Discharge Quantity Along with 1.1 MLD sewage (Avg. MLD)	April-23	1.398	2.122	May-23	1.369	2.016	June-23	1.432	2.424	July-23	1.553	2.684	August-23	1.560	2.331	September-23	1.585	2.678	Chemicals	Apr.-23	May-23	June-23	July-23	Aug.-23	Sep.-23	Lime	4452 2	400 18.6	453 56.2	446 63.6	458 80	4539 1.8	H₂O₂	65	135	0	0	0	0	FeSO₄ (solid)	0	0	0	0	0	0	Polyelectrolyte	2	23	4	8	3	6	De foaming Agent	0	0	0	0	113	67	Fin Deform-18	6050	410 0	530 0	622 0	553 0	3700	Phosphoric Acid	500	750	750	500	770	750
Month	Average Inlet Effluent (MLD) (2.2 MLD Industrial Effluent)	Final Discharge Quantity Along with 1.1 MLD sewage (Avg. MLD)																																																																													
April-23	1.398	2.122																																																																													
May-23	1.369	2.016																																																																													
June-23	1.432	2.424																																																																													
July-23	1.553	2.684																																																																													
August-23	1.560	2.331																																																																													
September-23	1.585	2.678																																																																													
Chemicals	Apr.-23	May-23	June-23	July-23	Aug.-23	Sep.-23																																																																									
Lime	4452 2	400 18.6	453 56.2	446 63.6	458 80	4539 1.8																																																																									
H₂O₂	65	135	0	0	0	0																																																																									
FeSO₄ (solid)	0	0	0	0	0	0																																																																									
Polyelectrolyte	2	23	4	8	3	6																																																																									
De foaming Agent	0	0	0	0	113	67																																																																									
Fin Deform-18	6050	410 0	530 0	622 0	553 0	3700																																																																									
Phosphoric Acid	500	750	750	500	770	750																																																																									

		<table border="1"> <tbody> <tr> <td>Poly Aluminum Chloride (PAC)</td> <td>225</td> <td>185</td> <td>295</td> <td>378</td> <td>367</td> <td>359</td> </tr> <tr> <td>Sodium Tripolyphosphate (STTP)</td> <td>143</td> <td>145</td> <td>125</td> <td>75</td> <td>50</td> <td>62</td> </tr> <tr> <td>MgCl₂</td> <td>868</td> <td>880</td> <td>870</td> <td>924</td> <td>924</td> <td>896</td> </tr> <tr> <td>Na₂HPO₄</td> <td>0</td> <td>0</td> <td>0</td> <td>0</td> <td>0</td> <td>0</td> </tr> <tr> <td>Caustic Soda (NaOH)</td> <td>602.7</td> <td>462.07</td> <td>703.15</td> <td>321.44</td> <td>497.4</td> <td>545.25</td> </tr> </tbody> </table>	Poly Aluminum Chloride (PAC)	225	185	295	378	367	359	Sodium Tripolyphosphate (STTP)	143	145	125	75	50	62	MgCl₂	868	880	870	924	924	896	Na₂HPO₄	0	0	0	0	0	0	Caustic Soda (NaOH)	602.7	462.07	703.15	321.44	497.4	545.25
Poly Aluminum Chloride (PAC)	225	185	295	378	367	359																															
Sodium Tripolyphosphate (STTP)	143	145	125	75	50	62																															
MgCl₂	868	880	870	924	924	896																															
Na₂HPO₄	0	0	0	0	0	0																															
Caustic Soda (NaOH)	602.7	462.07	703.15	321.44	497.4	545.25																															
V	The CETP operator will maintain an annual register of member units which will contain the details of products with installed capacities and quality and quantity of effluents accepted for discharged. This will form a part of the initial and renewal applications for consent to operate to be made before the SPCB.	Noted																																			
VI	No changes in installed capacity, quantity or quality of effluents as agreed upon in the initial MOU between the operator and the member units, addition of any new member units shall be carried without prior approval of ministry.	Noted																																			
VII	The unit shall inform the SPCB at least a week prior to undertaking maintenance activities in the recycle system and store treated effluents under their advice in the matter.	<p>Shall be complied.</p> <p>We are complying the same for existing operation (i.e., 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.</p>																																			
VIII	The unit shall also immediately inform the PCB of any breakdown in the recycling system, store the effluents in the interim period and dispose effluents only as advised by the PCB.	<p>Shall be complied.</p> <p>We are complying the same for existing operation (i.e. 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.</p>																																			
IX	The MOU between CETP and member units shall indicate the maximum quantity of effluent to be sent to the CETP along with the quality.	<p>Complied</p> <p>We are complying the same for existing operation (i.e., 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.</p>																																			
X	The unit shall maintain a robust system of conveyance for primary treated effluents from the member units and constantly monitor the influent quality to the CETP. The management of the CETP and the individual member shall be jointly and	Noted																																			

	severally responsible for conveyance and pre-treatment of effluents to the CETP which have a valid consent of the PCB and which meet the primary treated standards as prescribed. the CETP operator shall with the consent of the SPCB retain the powers to delink the defaulter unit from entering the conveyance system.	
XI	The effluent from member units shall be transported through pipeline. In case the effluent is transported through road, it shall be transported through CETP tankers only duly maintaining proper manifest system. The vehicles shall be fitted with proper GPS system.	Shall be Complied Currently also the effluent is transported through road by CETP tankers fitted with GPS and proper manifest system.
XII	Before accepting any effluent from member units, the same shall be as permitted by the SPCB in the consent order. No effluent from any unit shall be accepted without consent from SPCB under the Water Act, 1974 as amended.	Shall be Complied We are complying the same for existing operation (i.e. 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.
XIII	Treated water shall be disposed on land for irrigation. An irrigation management plan shall be drawn up in consultation with and to the satisfaction of the SPCB.	Not Applicable
XIV	The project proponents will build operate and maintain the collection and conveyance system to transport effluents from the industrial units in consultation with and to the satisfaction of the SPCB and ensure that the industrial units meet the primary effluent standards prescribed by the SPCB.	Complied The conveyance of effluent from member units to CETP is done through dedicated rubber lined tankers, which is agreed by SPCB.
XV	The SPCB will also evaluate the treatment efficiency of the effluent treatment plant and its capability of meeting the prescribed standards. The final scheme of treatment would be such as is approved by the PCB in the CTE.	Noted
XVI	The project proponents will create an institutional arrangement for the involvement of individual members in the management of the CETP.	Noted. In the board of Directors of company, two representatives are included.

III. Noise monitoring and preservation:

I	Noise level survey shall be carried as per the prescribed guidelines and report in this regard shall be submitted to regional	Shall be complied.
---	---	--------------------

officer of the ministry as a part of six-monthly compliance report.

We are complying the same for existing operation (i.e. 2.2 MLD industrial effluent) and will comply the same after implementation of 3.5 MLD industrial effluent project.

SR.NO.	DATE	LOCATION	DAY TIME	NIGHTTIME
			NOISE MONITORING	NOISE MONITORING
			AT 12.00 Hrs.	AT 10.00 Hrs.
			LIMIT 75 dba	LIMIT 70 dba
1	13.04.2023	Near Main Gate	63.7	45.1
2		Near Decanter	48.5	53.7
3		Near Aeration	70.3	63.8
4		Near Final Discharge	49.9	48.9
5	12.05.2023	Near Main Gate	58.4	46.7
6		Near Decanter	46.3	49.7
7		Near DG Room	67.1	66.3
8		Near Final Discharge	55.3	50.6
9	20.06.2023	Near Main Gate	57.6	50.8
10		Near Decanter	55.3	52.3
11		Near DG Room	52.6	65.2
12		Near Final Discharge	51.1	47.2
13	13.07.2023	Near Main Gate	61.2	49.2
14		Near Decanter	56.3	52.3
15		Near DG Room	69.4	67.3
16		Near Final Discharge	52.7	46.9
17	13.08.2023	Near Main Gate	62.5	52.1
18		Near Decanter	59.6	50.3
19		Near DG Room	72.3	65.8
20		Near Final Discharge	51.3	46.3
21	13.09.2023	Near Main Gate	64.7	53.1
22		Near Decanter	60.4	51.9
23		Near DG Room	71.5	66.3
24		Near Final Discharge	52.8	48.8

II Noise from vehicles, power machinery and equipment should be regularly serviced. Attention should also be given to muffler maintenance and enclosure of noisy equipment's.

Complied
We are complying the same for existing operation (i.e., 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.

III	Acoustic enclosures for DG set, noise barriers for ground-run bays, ear plugs for operating personnel shall be implemented as mitigation measures for noise impact due to ground sources.	<p>Complied</p> <p>PPEs are Provided near High noise area.</p> <p>We are complying the same for existing operation (i.e., 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.</p>
-----	---	---

IV. Waste management:

I	ETP sludge generated from CETP facility shall be handled and disposed to nearby authorized TSDF site as per hazardous and other wastes rules,2016.	<p>Complied.</p> <p>Unit is disposing sludge to Common TSDF –BEIL for their existing operation and will comply the same for proposed operation after implementation. Sludge disposal quantity for existing facility is under: (April-2023 to September-2023). Noted for compliance as the 1.8 to 3.5 MLD effluent project is not yet implemented.</p> <table border="1" data-bbox="758 853 1474 1178"> <thead> <tr> <th>Month</th> <th>Sludge Quantity (MT)</th> <th>Consented Qty. in MT/Year</th> </tr> </thead> <tbody> <tr> <td>April-23</td> <td>204.55</td> <td rowspan="6">36500</td> </tr> <tr> <td>May-23</td> <td>224.32</td> </tr> <tr> <td>June-23</td> <td>272.20</td> </tr> <tr> <td>July-23</td> <td>247.23</td> </tr> <tr> <td>August-23</td> <td>299.44</td> </tr> <tr> <td>September-23</td> <td>295.27</td> </tr> </tbody> </table> <p>Membership certificate of BEIL to send sludge attached as Annexure -1(B)</p>	Month	Sludge Quantity (MT)	Consented Qty. in MT/Year	April-23	204.55	36500	May-23	224.32	June-23	272.20	July-23	247.23	August-23	299.44	September-23	295.27
Month	Sludge Quantity (MT)	Consented Qty. in MT/Year																
April-23	204.55	36500																
May-23	224.32																	
June-23	272.20																	
July-23	247.23																	
August-23	299.44																	
September-23	295.27																	
II	Non-hazardous solid wastes and sludge arising out of the operation of the CETP shall be adequately disposed as per the consent to be availed from the state pollution control board. Non-hazardous solid waste and sludge shall not be mixed with hazardous wastes.	<p>Complied</p> <p>We are complying the same for existing operation (i.e. 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.</p>																
III	The CETP shall have adequate power back up facility, to meet the energy requirement in case of power failure from the grid.	<p>Shall be Complied</p> <p>For existing operation, as power back ETL has installed D G Set of 1010 KVA for smooth operation during power failure. After implementation of the project an additional DG set of 1010 KVA shall be installed to meet the energy requirement in case of power failure.</p>																
IV	The site for aerobic composting shall be selected and developed in consultation with and to the satisfaction of the SPCB.	Not applicable																

	Odor and inspect nuisance shall be adequately controlled.	
V	Any wastes from construction and demolition activities related thereto shall be managed so as to strictly conform to the construction and demolition waste, management rules,2016.	Noted
VI	The solid wastes shall be segregated, managed, and disposed as per the norms of the solid waste management rules,2016.	Noted

V. Energy conservation measures:

I	Provide solar power generation on roof tops of buildings, for solar light system for all common areas, streetlights, parking around project area and maintain the same regularly.	Noted We are working out the viability.
II	Provide LED lights in their offices and residential areas.	Shall be complied. We are complying the same for existing operation (i.e. 2.2 MLD industrial effluent) and will comply the same after implementation of proposed project.

VI. Green belt:

I	Green belt shall be developed in area as provided in project details, with native tree green belt shall be developed in an area equal to 33% of the plant area with a native tree species in accordance with CPCB guidelines. The greenbelt shall inter alia cover the entire periphery of the plant.	Shall be complied. There is no increase in land area for the proposed 3.5 MLD project, therefore green belt will remain the same. Currently 18% is the green belt area. Plant Layout attached as Annexure-1(D)
---	---	--

VII. Public hearing and human health issues:

I	Emergency preparedness plan based on the hazard identification and risk assessment and disaster management plan shall be implemented.	We have Onsite Emergency Action Plan.
II	Adequate infrastructure, including power, shall be provided for emergency situations and disaster management.	Complied Adequate firefighting system is installed at site

		For existing operation, as power back up, ETL has installed D G Set of 1010 KVA for smooth operation during power failure. After implementation of the project an additional DG set of 1010 KVA shall be installed to meet the energy requirement in case of power failure.
III	Provision shall be made for the housing of construction labour within the site with all necessary infrastructure and facilities such as fuel for cooking, mobile toilets, mobile STP, safe drinking water, medical health care, creche etc. the housing may be in the form of temporary structures to be removed after the completion of the project.	Noted
IV	Occupational health surveillance of the workers shall be done on a regular basis.	Complied. Health surveillance of workers is carried out six monthly.

IX. Corporate Environment Responsibility:

I	The company shall have a well laid down environmental policy duly approve by the board of directors. The environmental policy should prescribe for standard operating procedures to have proper checks and balances and to bring into focus any infringements/deviation/violation of the environmental/forest/wildlife norms/ condition. The company shall have defined system of reporting infringements/deviation/violation of the environmental/forest/wildlife norms/conditions and/or shareholders/stake holders. The copy of the board resolution in this regard shall be submitted to the MoEF&CC as a part of six-monthly report.	Complied. The company has ICP policy and is implementing all aspects.
II	A separate Environmental cell both at the project and company head quarter level with qualified personal shall be set up under the control of senior executive, who will directly to the head of the organization.	Complied
III	Action plan for implementing EMP and environmental conditions along with responsibility matrix of the company shall be prepared and shall be duly approved by competent authority. The	Noted for compliance. Our unit is a CETP and hence all the expenditure is for the purpose of environment protection measures.

	year wise funds earmarked for environmental protection measures shall be kept in separate account and not to be diverted for any other purpose. Year wise progress of implementation of action plan shall be reported to the ministry/regional office along with six monthly compliance report.	
IV	Self-environmental audit shall be conducted annually. Every three years third party environmental audit shall be carried out.	Complied. An environment audit is carried out by a third party every year. The third party (Schedule – I) auditors are appointed by GPCB.

X. Miscellaneous:

II	The project proponent shall prominently advertise it at least in two local newspapers of the district or state, of which one shall be in the vernacular language within seven days indicating that the project has been accorded environment clearance and the details of MoEF&CC/SEIAA website where it is displayed.	Complied Having received the EC on 26 th December, we have advertised in two local newspapers (Times of India and Divya Bhaskar) on date 01 st January 2020 & 31 st December 2019 informing that the “project has been accorded EC”. Copy is attached as Annexure - 1 (E)
III	The copies of the environmental clearance shall be submitted by the project proponents to the heads of local bodies, panchayats, and municipal bodies in addition to the relevant offices of the government who in turn has to display the same for 30 days from the date of receipts.	Complied We have submitted the copy of EC to concerned panchayat, Zilla Parishad/municipal Corporation, Urban Local body, and the local NGO Acknowledgement sheet attached as Annexure-1 (F)
III	The project proponent shall upload the status of compliance of the stipulated environment clearance conditions, including results of monitored data on their website and update the same on half yearly basis.	Complied Half yearly EC Compliance report uploaded on website.
IV	The project proponent shall submit six-monthly reports on the status of the compliance of stipulated environmental conditions on the website of the ministry of Environmental, Forest and Climate change at environmental clearance portal.	Shall be Complied

V	The project proponent shall submit the environmental statement for each financial year in Form-5 to the concerned state pollution control board as prescribed under the environment rules, 1986, as amended subsequently and put on the website of the company.	Complied Copy of Environmental statement for the year of 2021-22 is attached as Annexure – (G)
VI	The criteria pollutant levels or critical sectoral parameters indicated for the project shall be monitored and displayed at a convenient location near the main gate of the company in the public domain.	We are displaying information outside gate
VII	The project proponent shall inform the regional office as well as the ministry, the date of financial closure and final approval of the project by the concerned authorities, commencing the land development work and start of operation by the project.	Shall be complied.
VIII	The project authorities must strictly adhere to the stipulations made by the state pollution control board and the state government.	Noted
IX	The project proponent shall abide by all commitments and recommendations made in the EIA/EMP report, commitment made during public hearing and also that during their presentation to the expert appraisal committee.	Noted
X	No further expansion or modifications in the plant shall be carried out without prior approval of the ministry of environment, forest, and climate change.	Noted
XI	Concealing factual data or submission of false/fabricated data may result in revocation of this environment clearance and attract under the provisions of environment act 1986.	Noted
XII	The ministry may revoke or suspend the clearance, if implementation of any of the above conditions is not satisfactory.	Noted
XIII	The ministry reserves the right to stipulate additional conditions if found necessary. The company in a time	Noted

	bound manner shall implement these conditions.	
XI V	The regional office of the ministry shall monitor compliance of the stipulated conditions. The project authorities should extend full corporation to the officer of the regional office by furnishing the requisite data/information/monitoring reports.	Noted
XV	The above conditions shall be enforced, inter-alia under the provisions of the water(prevention & control of pollution) Act, 1974, the Air (prevention & control of pollution) Act, 1981, the Environment (protection) Act, 1986, Hazardous and other wastes (Management and transboundary movement)Rules, 2016 and the public liability insurance Act,1991 along with their amendments and rules and any other order passed by the Hon'ble supreme Court of India/High courts and any other court of Law relating the subject matter.	Noted
XVI	Any appeal against this EC shall lie with the national green tribunal, if preferred within a period of 30 days as prescribed under section 16 of the national green tribunal act 2010.	Noted

6. This issues with the approval of the Competent authority. – Noted.



Shroff S.R. Rotary Institute of Chemical Technology



Principal Supporter & Sponsor – UPL Ltd & Shroff Family
Managed by Ankleshwar Rotary Education Society
Constituent Institute of UPL University of Sustainable Technology



Test Report

Customer Name & Address: M/s. Enviro Technology Ltd. Plot no. 2413/14 GIDC Estate, Ankleshwar Dist: Bharuch	Report No :SRICT/EAUDIT/20230504/A-01 Issue Date: 04/05/2023 Contact person:- Mr. Narendra Patel
---	--

Sample Id Code	:	SRICT/20230411/A-01			
Sample Description	:	ETL F/O			
Date of sampling	:	11/04/2023	Sample received By	:	SRICT Audit Team
Date of sample received	:	11/04/2023	Test parameter	:	As mentioned in CCA
Date of starting Analysis	:	13/04/2023	Quantity of Sample	:	2 Lit.
Date of completion Analysis	:	17/04/2023	Packed/Seal	:	Packed
No. Of Samples	:	01			

RESULTS

Sr No	Parameter	Unit	Result	Permissible Limit	Method
1	pH	--	7.52	6.5 to 8.5	IS 3025(P-11) : 2022,Electrometric Method
2	Temperature	°C	28	40	APHA (23rd Ed) 2550
3	Colour	Hazen	6389	100 CU	APHA 2120 C, 2-7 to 2-8, 23rd Ed.: 2017,Spectrophotometric Single Wavelength Method
4	Total Suspended solids (TSS)	mg/l	89	150	IS3025(P-17) 1984 Amd.1 : 1999,Gravimetric Method
5	Total Dissolved Solid (TDS)	mg/l	19410	10000	IS3025(P-16), 1984,Gravimetric Method
6	BOD	mg/l	26	200	IS:3025 (Part 44), Amd.1:2000,Oxygen Depletion Method
7	COD	mg/l	673.20	1000	IS: 3025-Part 58, 2006,Open Reflux Method

Page 1 of 3



Shroff S.R. Rotary Institute of Chemical Technology



Principal Supporter & Sponsor – UPL Ltd & Shroff Family
Managed by Ankleshwar Rotary Education Society
Constituent Institute of UPL University of Sustainable Technology



8	Oil & Grease	mg/l	BDL	10	APHA 5520-B, 5-42 to 44, 23rd Ed.: 2017, Liquid Partition Gravimetric Method
9	Phenolic compound	mg/l	0.68	5	APHA, 5530-D, Page No. 5-52, 23rd Ed.: 2017, Direct Photometric Method
10	Sulphide	mg/l	BDL	5	APHA 4500-S-2-F, 4-187, 23rd Ed.: 2017, Iodometric Method
11	Ammonical Nitrogen	mg/l	40.32	50	IS: 3025-Part 34, 1988, Titrimetric Method
12	Total Kjeldahl Nitrogen	mg/l	43.68	50	APHA-4500-Norg-B, Macro- Kjeldahl Method, 23rd Ed.
13	Phosphate	mg/l	2.15	5	IS: 3025(P-31)1988Re-2003, Stannous chloride Method.
14	Chlorides as Cl	mg/l	7858.55	1000	IS: 3025-Part 32, 1988, Argentometric Method
15	Sulphate as SO ₄	mg/l	2289	1000	APHA, 4500-SO ₄ -E, 4-199 to 200, 23rd Ed.: 2017, Turbidimetric Method
16	Cyanide	mg/l	BDL	0.2	APHA(23rd Ed) 4500-D, Titrimetric method
17	Fluorides	mg/l	1.52	15	APHA 4500-F- D, 4-90 TO 4-91, 23rd Ed., : 2017, SPADNS Method
18	Hexavalent Chromium	mg/l	BDL	0.1	APHA(23rd Ed) 3500Cr-B, Colourimetric Method
19	Total Chromium	mg/l	0.13	2	AAS-APHA (23rd Ed) 3111-B, Colourimetric Method
20	Copper	mg/l	0.23	3	APHA 3111-CU-B, 3-20 TO 3-31, 23rd Ed. 2017 AAS
21	Nickel	mg/l	BDL	3	AAS-APHA 3111-Ni-B, 3-20 to 3-21, 23rd Ed. 2017
22	Zinc	mg/l	0.91	15	AAS-APHA, 3111-Zn-B, 3-20 TO 3-21, 23rd Ed. 2017
23	Iron	mg/l	1.09	3	APHA-3111-Fe.B, 3-20 to 3-21, 23rd Ed. 2017
24	Manganese	mg/l	0.18	2	APHA 3111 A, 23rd Ed. 2017-AAS
25	Mercury	mg/l	BDL	0.01	APHA-3112-Hg-B, 23rd Ed. 2017-AAS



Shroff S.R. Rotary Institute of Chemical Technology




Principal Supporter & Sponsor – UPL Ltd & Shroff Family
Managed by Ankleshwar Rotary Education Society
Constituent Institute of UPL University of Sustainable Technology



26	Lead	mg/l	BDL	0.1	AAS-APHA 3111-Pb-B,3-20 to 3-21,23 rd. ED.2017
27	Arsenic	mg/l	BDL	0.2	APHA 3111-AS-B,23 rd. ED.2017-AAS
28	Vanadium	mg/l	BDL	0.2	APHA-3500-V.B-AAS
29	Cadmium	mg/l	BDL	0.05	APHA 3111-Cd B , 23 rd. ED.2017-AAS
30	Selenium	mg/l	BDL	0.05	APHA-3500-Se, B-C-23 rd. ED.2017-AAS
31	Insecticide/Pesticides	µg/l	ND	Absent	Pesticides & insecticides Ref. USEPA 508,525.2

BDL – Below Detection Limit

ND – Not Detected


Prepared by


Checked by


Verified by

Terms and conditions governing the test report issued

- 1.The results are applicable only to the given samples.
- 2.The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
- 3.The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
- 4.Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.



Shroff S.R. Rotary Institute of Chemical Technology



Principal Supporter & Sponsor – UPL Ltd & Shroff Family
Managed by Ankleshwar Rotary Education Society
Constituent Institute of UPL University of Sustainable Technology



Group : Waste Water
Discipline : Chemical

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd. Plot no. 2413/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Narendra Patel	Report No : SEL/20230522/A-001 Issue Date: 27/05/2023
---	--

Lab Id Code	:	SRICT/20230522/A-001			
Sample Description	:	Final O/L-001	Purpose	:	Testing
Date of sample received	:	22/05/2023	Test parameter	:	As mentioned by customer
Date of starting Analysis	:	23/05/2023	Quantity	:	2 Lit
Date of completion Analysis	:	26/05/2023	Packed/Seal	:	Sealed

Sr No	Parameter	Unit	Result	Permissible Limit (If Applicable)	Method
1	Temperature	°C	28.6	40	APHA (23rd Ed) 2550
2	Total Kjeldahl Nitrogen	mg/l	45.92	50	APHA-4500-Norg-B, Macro- Kjeldahl Method, 23rd Eddi.
3	Phosphate	mg/l	2.02	5	IS: 3025(P-31)1988Re-2003, Stannous chloride Method.
4	Cyanide	mg/l	BDL	0.2	APHA(23rd Ed)4500-D, Titrimetric method
5	Fluorides	mg/l	0.15	15	APHA 4500-F- D, 4-90 TO 4-91, 23rd Ed., : 2017, SPADNS Method
6	Hexavalent Chromium	mg/l	BDL	0.1	APHA(23rd Ed) 3500Cr-B, Colourimetric Method
7	Total Chromium	mg/l	0.16	2	AAS-APHA (23rd Ed) 3111-B, Colourimetric Method
8	Copper	mg/l	0.65	3	APHA 3111-CU-B,3-20 TO 3-31,23 rd. ED.2017 AAS
9	Nickel	mg/l	BDL	3	AAS-APHA 3111-Ni-B,3-20 to 3-21,23 rd. ED.2017
10	Zinc	mg/l	0.89	15	AAS-APHA,3111-Zn-B,3-20 TO 3-21,23 rd. ED.2017
11	Iron	mg/l	1.03	3	APHA-3111-Fe.B,3-20 to 3-21,23 rd. ED.2017



Shroff S.R. Rotary Institute of Chemical Technology



Principal Supporter & Sponsor – UPL Ltd & Shroff Family
Managed by Ankleshwar Rotary Education Society
Constituent Institute of UPL University of Sustainable Technology



12	Manganese	mg/l	0.11	2	APHA 3111 A , 23 rd. ED.2017-AAS
13	Mercury	mg/l	BDL	0.01	APHA-3112-Hg-B,23 rd. ED.2017-AAS
14	Lead	mg/l	BDL	0.1	AAS-APHA 3111-Pb-B,3-20 to 3-21,23 rd. ED.2017
15	Arsenic	mg/l	BDL	0.2	APHA 3111-AS-B,23 rd. ED.2017-AAS
16	Vanadium	mg/l	BDL	0.2	APHA-3500-V.B-AAS
17	Cadmium	mg/l	BDL	0.05	APHA 3111-Cd B , 23 rd. ED.2017-AAS
18	Selenium	mg/l	BDL	0.05	APHA-3500-Se, B-C-23 rd. ED.2017-AAS
19	Insecticide/Pesticides	mg/l	Absent	Absent	Pesticides & Insecticides Ref. USEPA 508,525.2

BDL – Below Detection Limit, ND – Not Detected

Prepared and checked By

Authorized Signatory

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT



Shroff S.R. Rotary Institute of Chemical Technology



Principal Supporter & Sponsor – UPL Ltd & Shroff Family
Managed by Ankleshwar Rotary Education Society
Constituent Institute of UPL University of Sustainable Technology



Group : Waste Water
Discipline : Chemical

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2413/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Narendra Patel	Report No : SEL/20230628/A-001 Issue Date: 04/07/2023
--	--

Lab Id Code	:	SRICT/20230628/A-001			
Sample Description	:	Final O/L-001	Purpose	:	Testing
Date of sample received	:	28/06/2023	Test parameter	:	As mentioned by customer
Date of starting Analysis	:	30/06/2023	Quantity	:	2 Lit
Date of completion Analysis	:	03/07/2023	Packed/Seal	:	Sealed

Sr No	Parameter	Unit	Result	Permissible Limit (If Applicable)	Method
1	Temperature	°C	28.6	40	APHA (23rd Ed) 2550
2	Total Kjedadhl Nitrogen	mg/l	47.04	50	APHA-4500-Norg-B, Macro- Kjedadhl Method, 23rd Eddi.
3	Phosphate	mg/l	1.98	5	IS: 3025(P-31)1988Re-2003, Stannous chloride Method.
4	Cyanide	mg/l	BDL	0.2	APHA(23rd Ed)4500-D, Titrimetric method
5	Fluorides	mg/l	0.13	15	APHA 4500-F- D, 4-90 TO 4-91, 23rd Ed., : 2017, SPADNS Method
6	Hexavalent Chromium	mg/l	BDL	0.1	APHA(23rd Ed) 3500Cr-B, Colourimetric Method
7	Total Chromium	mg/l	0.14	2	AAS-APHA (23rd Ed) 3111-B, Colourimetric Method
8	Copper	mg/l	0.60	3	APHA 3111-CU-B,3-20 TO 3-31,23 rd. ED.2017 AAS
9	Nickel	mg/l	BDL	3	AAS-APHA 3111-Ni-B,3-20 to 3-21,23 rd. ED.2017
10	Zinc	mg/l	0.84	15	AAS-APHA,3111-Zn-B,3-20 TO 3-21,23 rd. ED.2017
11	Iron	mg/l	1.01	3	APHA-3111-Fe.B,3-20 to 3-21,23 rd. ED.2017



Shroff S.R. Rotary Institute of Chemical Technology



Principal Supporter & Sponsor – UPL Ltd & Shroff Family
Managed by Ankleshwar Rotary Education Society
Constituent Institute of UPL University of Sustainable Technology



12	Manganese	ng/l	0.12	2	APHA 3111 A , 23 rd. ED.2017-AAS
13	Mercury	mg/l	BDL	0.01	APHA-3112-Hg-B,23 rd. ED.2017-AAS
14	Lead	mg/l	BDL	0.1	AAS-APHA 3111-Pb-B,3-20 to 3-21,23 rd. ED.2017
15	Arsenic	mg/l	BDL	0.2	APHA 3111-AS-B,23 rd. ED.2017-AAS
16	Vanadium	mg/l	BDL	0.2	APHA-3500-V.B-AAS
17	Cadmium	mg/l	BDL	0.05	APHA 3111-Cd B , 23 rd. ED.2017-AAS
18	Selenium	mg/l	BDL	0.05	APHA-3500-Se, B-C-23 rd. ED.2017-AAS
19	Insecticide/Pesticides	mg/l	Absent	Absent	Pesticides &Insecticides Ref. USEPA 508,525.2

BDL – Below Detection Limit, ND – Not Detected

Prepared and checked By

Authorized Signatory

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT



Shroff S.R. Rotary Institute of Chemical Technology



Principal Supporter & Sponsor – UPL Ltd & Shroff Family
Managed by Ankleshwar Rotary Education Society
Constituent Institute of UPL University of Sustainable Technology



Group : Waste Water
Discipline : Chemical

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2413/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Narendra Patel	Report No : SEL/20230720/A-001 Issue Date: 25/07/2023
--	--

Lab Id Code	:	SRICT/20230720/A-001		
Sample Description	:	Final O/L-001	Purpose	: Testing
Date of sample received	:	20/07/2023	Test parameter	: As mentioned by customer
Date of starting Analysis	:	21/06/2023	Quantity	: 2 Lit
Date of completion Analysis	:	24/07/2023	Packed/Seal	: Sealed

Sr No	Parameter	Unit	Result	Permissible Limit (If Applicable)	Method
1	Temperature	°C	28.2	40	APHA (23rd Ed) 2550
2	Total Kjeldahl Nitrogen	mg/l	42.56	50	APHA-4500-Norg-B, Macro- Kjeldahl Method, 23rd Edition.
3	Phosphate	mg/l	1.94	5	IS: 3025(P-31)1988Re-2003, Stannous chloride Method.
4	Cyanide	mg/l	BDL	0.2	APHA(23rd Ed) 4500-D, Titrimetric method
5	Fluorides	mg/l	0.16	15	APHA 4500-F- D, 4-90 TO 4-91, 23rd Ed., : 2017, SPADNS Method
6	Hexavalent Chromium	mg/l	BDL	0.1	APHA(23rd Ed) 3500Cr-B, Colourimetric Method
7	Total Chromium	mg/l	0.15	2	AAS-APHA (23rd Ed) 3111-B, Colourimetric Method
8	Copper	mg/l	0.63	3	APHA 3111-CU-B, 3-20 TO 3-31, 23rd Ed. 2017 AAS
9	Nickel	mg/l	BDL	3	AAS-APHA 3111-Ni-B, 3-20 to 3-21, 23rd Ed. 2017
10	Zinc	mg/l	0.80	15	AAS-APHA, 3111-Zn-B, 3-20 TO 3-21, 23rd Ed. 2017
11	Iron	mg/l	1.05	3	APHA-3111-Fe.B, 3-20 to 3-21, 23rd Ed. 2017



Shroff S.R. Rotary Institute of Chemical Technology



Principal Supporter & Sponsor – UPL Ltd & Shroff Family
Managed by Ankleshwar Rotary Education Society
Constituent Institute of UPL University of Sustainable Technology



12	Manganese	mg/l	0.16	2	APHA 3111 A , 23 rd. ED.2017-AAS
13	Mercury	mg/l	BDL	0.01	APHA-3112-Hg-B,23 rd. ED.2017-AAS
14	Lead	mg/l	BDL	0.1	AAS-APHA 3111-Pb-B,3-20 to 3-21,23 rd. ED.2017
15	Arsenic	mg/l	BDL	0.2	APHA 3111-AS-B,23 rd. ED.2017-AAS
16	Vanadium	mg/l	BDL	0.2	APHA-3500-V.B-AAS
17	Cadmium	mg/l	BDL	0.05	APHA 3111-Cd B , 23 rd. ED.2017-AAS
18	Selenium	mg/l	BDL	0.05	APHA-3500-Se, B-C-23 rd. ED.2017-AAS
19	Insecticide/Pesticides	mg/l	Absent	Absent	Pesticides & Insecticides Ref. USEPA 508,525.2

BDL – Below Detection Limit, ND – Not Detected


Prepared and checked By


Authorized Signatory

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT



Shroff S.R. Rotary Institute of Chemical Technology



Principal Supporter & Sponsor – UPL Ltd & Shroff Family
Managed by Ankleshwar Rotary Education Society
Constituent Institute of UPL University of Sustainable Technology



Group : Waste Water
Discipline : Chemical

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2413/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Narendra Patel	Report No : SEL/20230828/A-001 Issue Date: 01/09/2023
--	--

Lab Id Code	:	SRICT/20230828/A-001		
Sample Description	:	Final O/L-001	Purpose	: Testing
Date of sample received	:	28/08/2023	Test parameter	: As mentioned by customer
Date of starting Analysis	:	29/08/2023	Quantity	: 2 Lit
Date of completion Analysis	:	01/09/2023	Packed/Seal	: Sealed

Sr No	Parameter	Unit	Result	Permissible Limit (If Applicable)	Method
1	Temperature	°C	24.9	40	APHA (23rd Ed) 2550
2	Total Kjeldahl Nitrogen	mg/l	41.44	50	APHA-4500-Norg-B, Macro- Kjeldahl Method, 23rd Eddi.
3	Phosphate	mg/l	2.12	5	IS: 3025(P-31)1988Re-2003, Stannous chloride Method.
4	Cyanide	mg/l	BDL	0.2	APHA(23rd Ed)4500-D, Titrimetric method
5	Fluorides	mg/l	0.5	15	APHA 4500-F- D, 4-90 TO 4-91, 23rd Ed., : 2017, SPADNS Method
6	Hexavalent Chromium	mg/l	BDL	0.1	APHA(23rd Ed) 3500Cr-B, Colourimetric Method
7	Total Chromium	mg/l	0.16	2	AAS-APHA (23rd Ed) 3111-B, Colourimetric Method
8	Copper	mg/l	0.71	3	APHA 3111-CU-B,3-20 TO 3-31,23 rd. ED.2017 AAS
9	Nickel	mg/l	0.18	3	AAS-APHA 3111-Ni-B,3-20 to 3-21,23 rd. ED.2017
10	Zinc	mg/l	0.68	15	AAS-APHA,3111-Zn-B,3-20 TO 3-21,23 rd. ED.2017
11	Iron	mg/l	1.20	3	APHA-3111-Fe.B,3-20 to 3-21,23 rd. ED.2017



Shroff S.R. Rotary Institute of Chemical Technology



Principal Supporter & Sponsor – UPL Ltd & Shroff Family
Managed by Ankleshwar Rotary Education Society
Constituent Institute of UPL University of Sustainable Technology



12	Manganese	mg/l	0.21	2	APHA 3111 A , 23 rd. ED.2017-AAS
13	Mercury	mg/l	BDL	0.01	APHA-3112-Hg-B,23 rd. ED.2017-AAS
14	Lead	mg/l	BDL	0.1	AAS-APHA 3111-Pb-B,3-20 to 3-21,23 rd. ED.2017
15	Arsenic	mg/l	BDL	0.2	APHA 3111-AS-B,23 rd. ED.2017-AAS
16	Vanadium	mg/l	BDL	0.2	APHA-3500-V.B-AAS
17	Cadmium	mg/l	BDL	0.05	APHA 3111-Cd B , 23 rd. ED.2017-AAS
18	Selenium	mg/l	BDL	0.05	APHA-3500-Se, B-C-23 rd. ED.2017-AAS
19	Insecticide/Pesticides	mg/l	Absent	Absent	Pesticides &Insecticides Ref. USEPA 508,525.2

BDL – Below Detection Limit, ND – Not Detected

Prepared and checked By

Authorized Signatory

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT



Shroff S.R. Rotary Institute of Chemical Technology



Principal Supporter & Sponsor – UPL Ltd & Shroff Family
 Managed by Ankleshwar Rotary Education Society
 Constituent Institute of UPL University of Sustainable Technology



Group : Waste Water
 Discipline : Chemical

TEST REPORT

Customer's Name & Address: M/s. Enviro Technology Ltd Plot no. 2413/14, GIDC Estate, Ankleshwar, Dist: Bharuch. Contact Person: Mr. Narendra Patel	Report No : SEL/20230911/A-001 Issue Date: 18/09/2023
--	--

Lab Id Code	:	SRICT/20230911/A-001
Sample Description	:	Final O/L-001
Date of sample received	:	11/09/2023
Date of starting Analysis	:	12/09/2023
Date of completion Analysis	:	16/09/2023
Purpose	:	Testing
Test parameter	:	As mentioned by customer
Quantity	:	2 Lit
Packed/Seal	:	Sealed

Sr No	Parameter	Unit	Result	Permissible Limit (If Applicable)	Method
1	Temperature	°C	25.1	40	APHA (23rd Ed) 2550
2	Total Kjeldahl Nitrogen	mg/l	35.28	50	APHA-4500-Norg-B, Macro- Kjeldahl Method, 23rd Eddi.
3	Phosphate	mg/l	2.54	5	IS: 3025(P-31)1988Re-2003, Stannous chloride Method.
4	Cyanide	mg/l	BDL	0.2	APHA(23rd Ed)4500-D, Titrimetric method
5	Fluorides	mg/l	1.2	15	APHA 4500-F- D, 4-90 TO 4-91, 23rd Ed., : 2017, SPADNS Method
6	Hexavalent Chromium	mg/l	BDL	0.1	APHA(23rd Ed) 3500Cr-B, Colourimetric Method
7	Total Chromium	mg/l	0.28	2	AAS-APHA (23rd Ed) 3111-B, Colourimetric Method
8	Copper	mg/l	0.95	3	APHA 3111-CU-B,3-20 TO 3-31,23 rd. ED.2017 AAS
9	Nickel	mg/l	0.12	3	AAS-APHA 3111-Ni-B,3-20 to 3-21,23 rd. ED.2017
10	Zinc	mg/l	0.56	15	AAS-APHA,3111-Zn-B,3-20 TO 3-21,23 rd. ED.2017
11	Iron	mg/l	1.95	3	APHA-3111-Fe.B,3-20 to 3-21,23 rd. ED.2017



Shroff S.R. Rotary Institute of Chemical Technology



Principal Supporter & Sponsor – UPL Ltd & Shroff Family
Managed by Ankleshwar Rotary Education Society
Constituent Institute of UPL University of Sustainable Technology



12	Manganese	mg/l	0.33	2	APHA 3111 A , 23 rd. ED.2017-AAS
13	Mercury	mg/l	BDL	0.01	APHA-3112-Hg-B,23 rd. ED.2017-AAS
14	Lead	mg/l	BDL	0.1	AAS-APHA 3111-Pb-B,3-20 to 3-21,23 rd. ED.2017
15	Arsenic	mg/l	BDL	0.2	APHA 3111-AS-B,23 rd. ED.2017-AAS
16	Vanadium	mg/l	BDL	0.2	APHA-3500-V.B-AAS
17	Cadmium	mg/l	BDL	0.05	APHA 3111-Cd B , 23 rd. ED.2017-AAS
18	Selenium	mg/l	BDL	0.05	APHA-3500-Se, B-C-23 rd. ED.2017-AAS
19	Insecticide/Pesticides	mg/l	Absent	Absent	Pesticides & Insecticides Ref. USEPA 508,525.2

BDL – Below Detection Limit, ND – Not Detected

Prepared and checked By

Authorized Signatory

Terms and conditions governing the test report issued

1. Sample is not drawn by SEL; the results are applicable only to the drawn samples.
2. The test report shall not be reproduced in full or part without the written approval of the SRICT Environmental Laboratory.
3. The test report in full or part shall not be used for promotional or publicity purpose without the written consent of SRICT Environmental Laboratory.
4. Water/Waste water samples shall be stored for the period of one month after the date of issue of Report.

END OF REPORT



March 5, 2013

Enviro Technology Ltd.
Plot No.2413/2414,
GIDC, Ankleshwar.

Sub : Membership Certificate for Common Solid Waste Disposal Facility.

Dear Sir,

We hereby certify that you have become member for the common Solid/Hazardous waste disposal facility of Bharuch Enviro Infrastructure Ltd., at GIDC, Ankleshwar. You have booked solid waste quantity of **36,000 MT / Year.** Your Membership No. is **Ank/048.**

Thanking you,

Yours faithfully,
For BHARUCH ENVIRO INFRASTRUCTURE LTD.

AUTHORISED SIGNATORY



DG CL

No. DGVCL/Tech-3/BRH/Addl-29/

Dakshin Gujarat Vij Company Ltd.

Nana Varachha Road, Kapodra Char Rasta
SURAT: 395 006.

12583-

Phone No.: 0261 - 2804231

Fax No.: 0261 - 2572636

Email dgvl.gebmail.com

Date:

12583-

"Save Energy for Benefit of Self and Nation"

27 MAR 2006

BY R.P.A.D.

To,

M/s Enviro Technology Limited,

2413 14, GIDC.

ANKLESHWAR - 393 002.

*AGH.
Bl. speak.
B.S.*

Sub: - Release of additional power of 125 KVA to raise your contract demand from 475 KVA to 600 KVA at GIDC, Ankleshwar - HT NO. 39564.

Ref: - (1) Estimate No: DGVCL/TECH-3/BRH/Addl-29/ 11749 Dtd. 27/02/06

(2) Agreement execution Date: - 23/03/06.

Dear Sir,

With reference to the above, this is to inform you that it is agreed to release additional load of 125 KVA during day and night hours in addition to existing load of 475 KVA presently drawn, raising your contract demand from 475 KVA to 600 KVA. Out of total contract demand of 600 KVA you are permitted to utilize 600 KVA only during day and night hours. The above load is released on contingent basis i.e. withdrawable at any time without giving any notice if the power position so warrants. This is subject to power cut in force from time to time.

You may please contact of E.E., Ankleshwar-Ind Dn. who will arrange to release supply as soon as he is ready on his side.

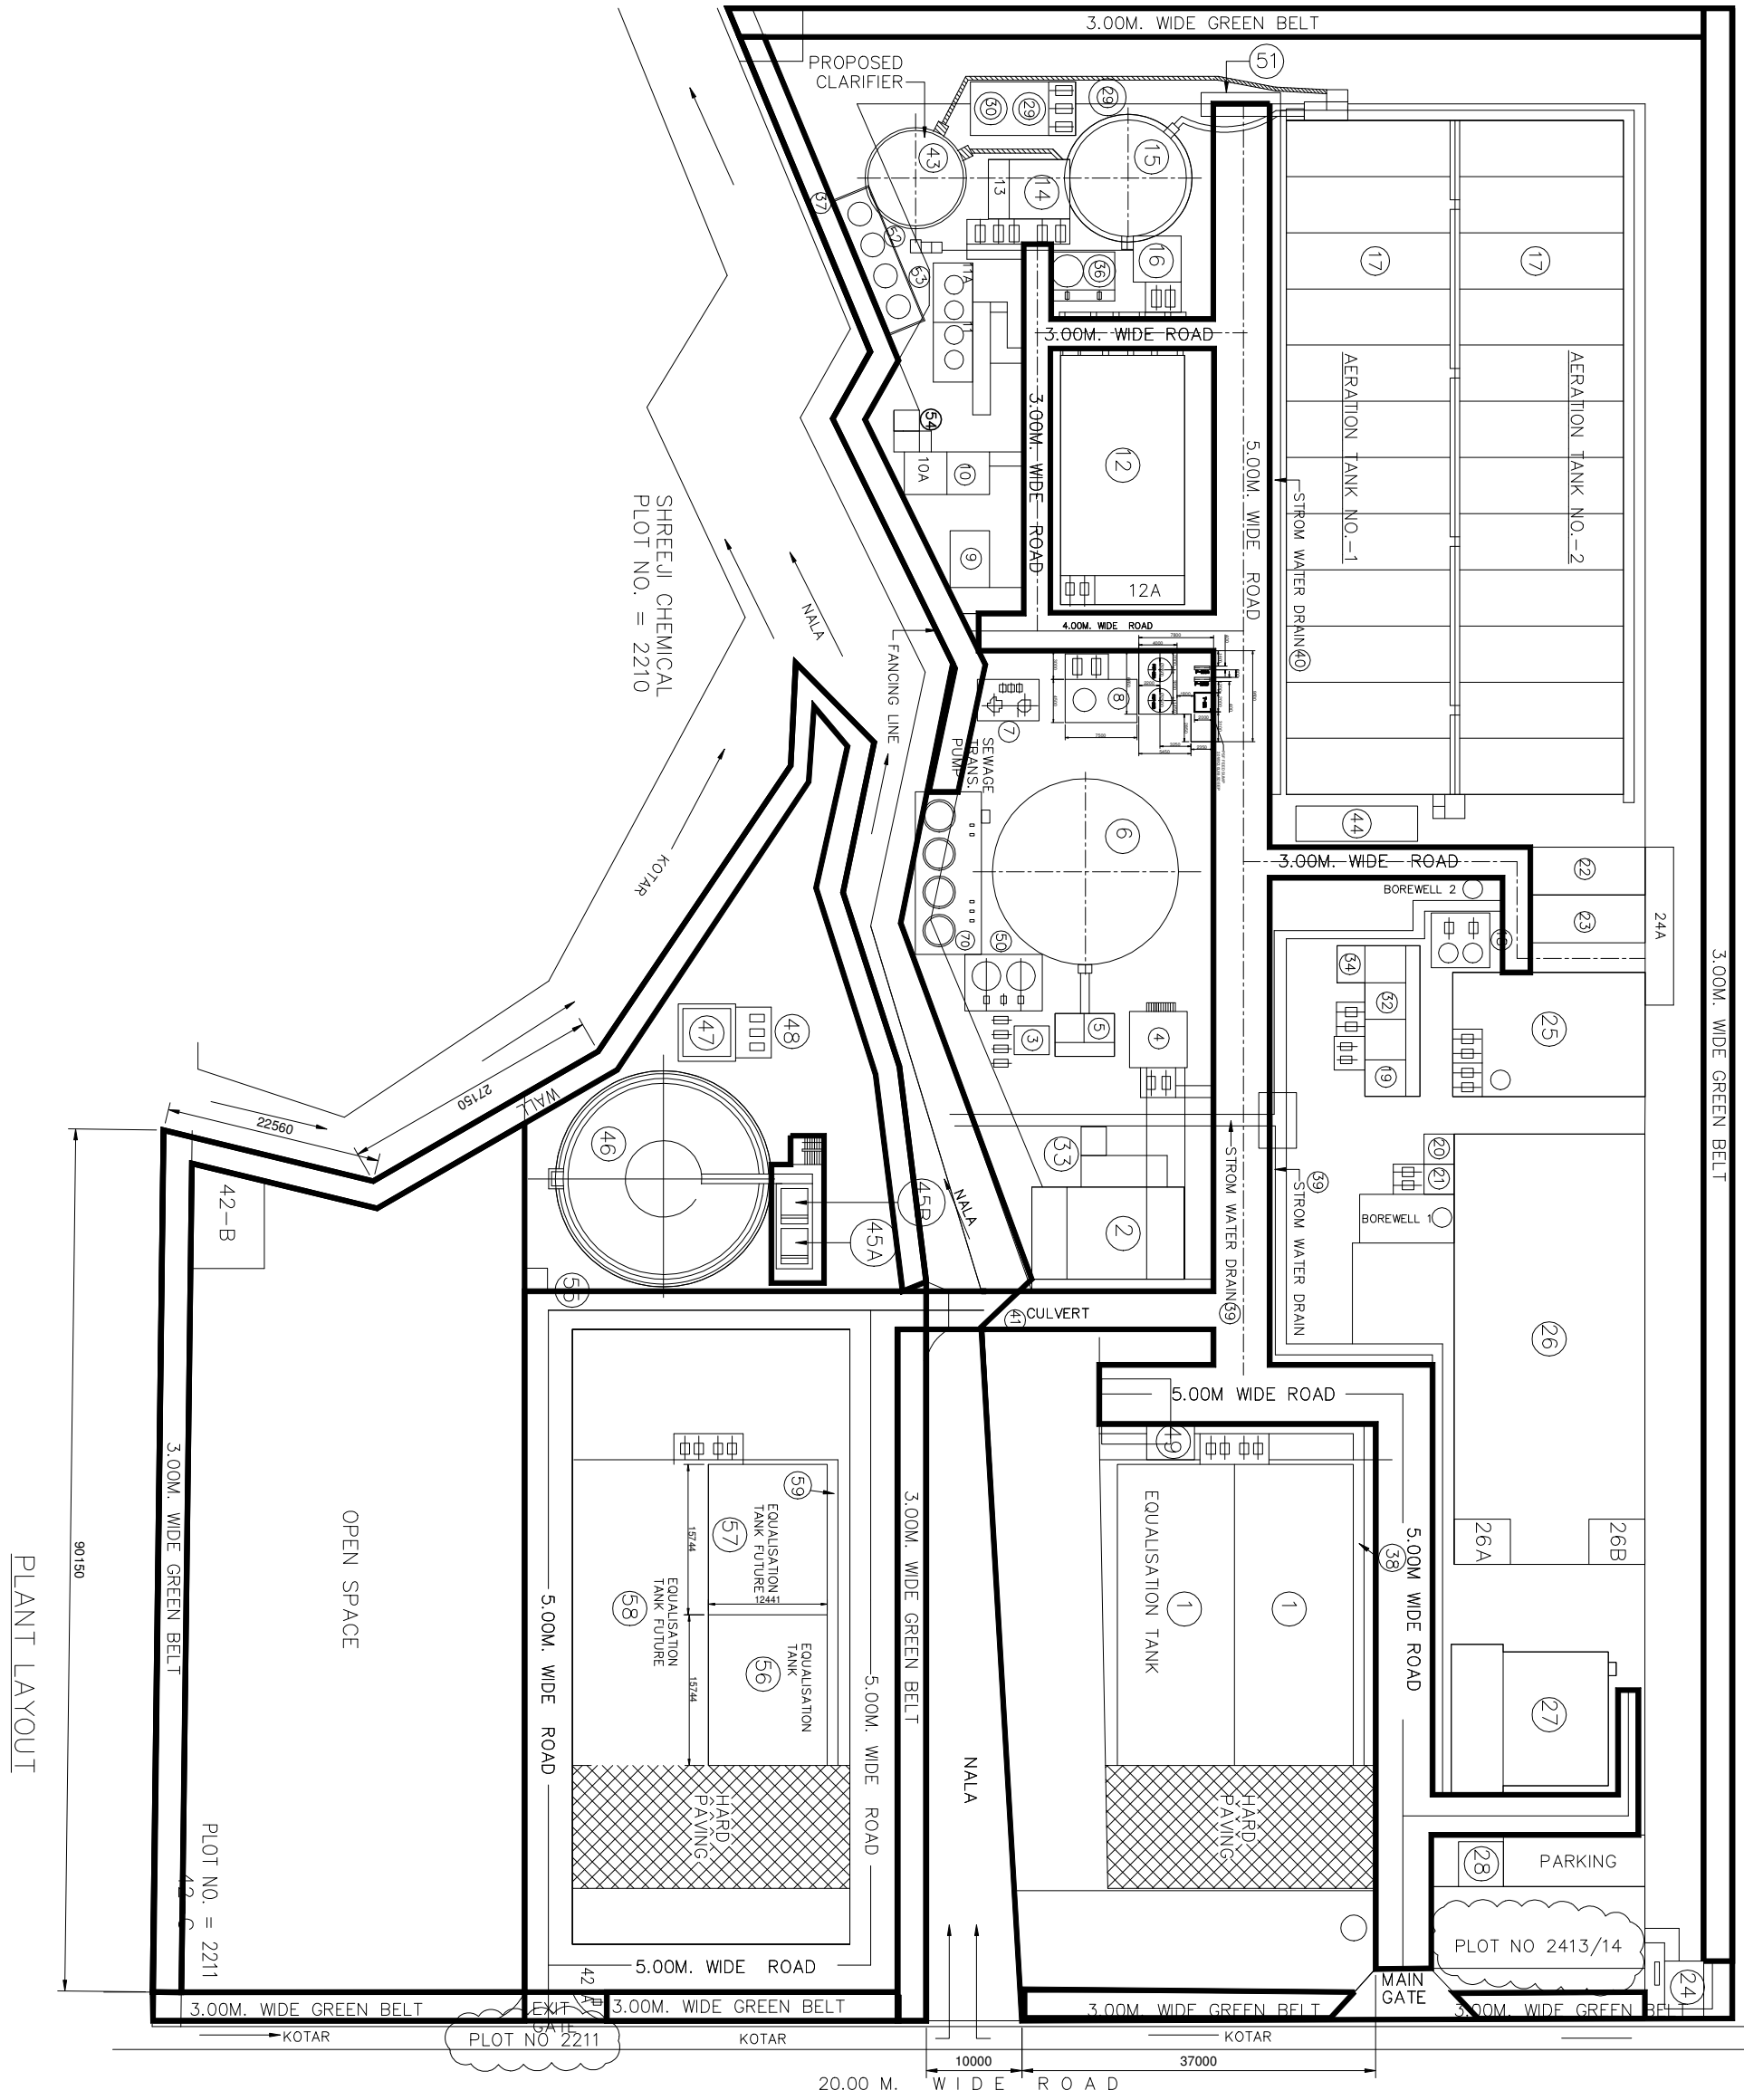
From the date of release of additional power you will be billed on the basis of increased contract demand of 600 KVA on tariff HTP- II A.

Actual power supply shall be released only after furnishing of No Objection Certificate (Not Site Clearance) from Gujarat Pollution Control Board GANDHINAGAR to our field office under intimation to this office, failing which the minimum bill shall commence after expiry of two months from the of issue of this letter, if you fail to avail this power within two months period from the date of this letter, you will be billed for your total contract demand inclusive of this additional load for monthly minimum charges after expiry of two months period from the date of issue of this letter as per provision of tariff as imposed from time to time for your total contract demand of 600 KVA which is inclusive of addl demand of 125 KVA.

Yours faithfully,

ADDL. CHIEF ENGINEER (O&M)

27/03/06



PLANT LAYOUT

SHREEJI CHEMICAL
PLOT NO. = 2210

PLOT NO. = 2211

PLOT NO 2413/14

20.00 M. WIDE ROAD

90150

22560

27150

42-B

3.00M. WIDE GREEN BELT

OPEN SPACE

5.00M. WIDE ROAD

5.00M. WIDE ROAD

5.00M WIDE ROAD

5.00M WIDE ROAD

3.00M. WIDE GREEN BELT

3.00M. WIDE GREEN BELT

3.00M. WIDE GREEN BELT

3.00M. WIDE GREEN BELT

KOTAR

KOTAR

KOTAR

10000

37000

3.00M. WIDE GREEN BELT

3.00M. WIDE GREEN BELT

PROPOSED CLARIFIER

FANING LINE

SEWAGE PUMPS

NALA

NALA

NALA

NALA

NALA

NALA

CULVERT

NALA

NALA

NALA

NALA

NALA

NALA

NALA

NALA

NALA

NALA

NALA

NALA

NALA

શ્રીરામ સિંઘ

India Post

8271948189543
R0948189543
RL ANKLESHWAR IE SO <393002>
Counter No:1,16/01/2020,14:37
To:DR HVC CHARY GUNTAPALLI,BHOPAL
PIN:462016, R.S.Nagar S.O
From:DHARUCH ENVIRO-INFRA,GIDC
Wt:55gms
Amt:35.00(Cash)
<Track on www.indiapost.gov.in>

ENVIRO TECHNOLOGY LIMITED

Date: 11.01.2020
PCB ID: 15074

To,
Dr H V C Chary Guntapalli, Scientist D
Ministry of Environment, Forest & Climate Change
Western Region Office,
Kendriya Paryavaran Bhavan,
Link Road No.3, E-5 Ravishankar Nagar
Bhopal-462016

Sub: Compliance of newspaper advertisement for the Ec No. 10-82/2018-IA-III dated 16th December,2019.

Ref: Environmental Clearance F. No. 10-82/2018-IA-III dated 16th December,2019.

Dear Sir,

With Reference to the aforesaid Environmental Clearance F. No. 10-82/2018-IA-III dated 16th December , 2019, has been received on 25-December-2019 for proposed expansion with modification of xisting common effluent treatment plant of M/s Enviro Technology limited (ETL), Ankleshwar.


As mentioned in the EC condition No. X (i), Ec receipt has to be published in newspaper within 7 days from the date of receipt of the clearance letter in at least two local newspapers.

We would like to inform that we have published in English (Times of India) on 01st January, 2020 and a vernacular language, Gujarati (Divya Bhaskar) Newspapers on 31st December, 2019.

The copies of the stated two newspapers are attached herewith for your reference and record.

Thanking you,

Yours Faithfully,
For, Enviro Technology Limited


B. D. Dalwadi
Chief Executive Officer

C.C: (1) Member Secretary
Gujarat Pollution Control Board
Paryavaran Bhavan, Sector-10/A, Gandhinagar-382010
(2) Regional Officer
Gujarat Pollution Control Board
Ankleshwar


18/01/2020
Gujarat Pollution Control Board
Head Office
Sector No. 10-A,
Gandhinagar-382010

Received
Gujarat Pollution Control Board
R.O Ankleshwar
16/1/2020

CIN NO. : U72200GJ1994PLC023786
Works Office : 2413/2414 & 2211, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)
Phone : (02646) 223569,252768 Fax : (02646) 250707
Email : dalwadibd@beil.co.in, darjiam@beil.co.in
Reg. Office : 970146, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)

ter beans and several other vegetables have risen too. According to Krishnakant Pawar, deputy secretary of APMC, Vashi, "Climate change happens to be the major factor for loss of production. The extended monsoon has badly hit farmers and destabilized the demand-

supply chain." At the wholesale APMC market in Vashi, supplies of onions have halved since September, say traders. The shortage of old onions and delay in harvesting the winter crop has kept prices high. "Mumbai market needs at least 100-125 truckloads of

sale market. During September and November last year, the prices were Rs 25-35 per kg, which jumped to Rs 50-130 per kg this year. To check prices, government stopped exports in September. This saw a slight dip in prices from Rs 50-60 per kg in the wholesale market to Rs 40-50 in October.

70 lakh a month as a retainer in one of the HDIL Group companies, according to chargesheet submitted in court by the Enforcement Directorate (ED) in the PMC Bank scam. The ED questioned her about the source of funds for the purchase of a bungalow in Bandra along with flats in Golf Links Building, and bungalows in Alibaug and Vasai.

Man kills his ailing 62-yr-old mother to 'relieve' her of pain

Sandhya.Nair
@timesgroup.com

Mumbai: A 30-year-old man allegedly killed his ailing 62-year-old mother to 'relieve' her of pain. The incident took place in the Bhabha Atomic Power Station (BARC) Colony at Tarapur on Sunday. The complainant, accused Jayprakash Dhobi's brother, has told the police his younger sibling was mentally unstable.

According to the complaint, the victim, Chandravati, was preparing breakfast for Jayprakash when he hit her on the head with an iron rod. The accused is single and unemployed. The complainant came to visit his mother after 11 am and saw Jayprakash sitting beside her body. An iron rod was lying near him. Jayprakash told the police his mother was suffering from arthritis, blood pressure, diabetes

and cataract. He told the police she often complained of pain and he killed her to liberate her. The victim lived along with her 70-year-old husband, a retired Tarapur Atomic Power Station (TAPS) employee and a daughter, who teaches at the (NPCIL School in Vasapur. Jayprakash and his older brother resided in different homes in Duttatraye Nagar in Boisar. They would visit their mother every Sunday.

Gift of life: City set for record, 79 transplants in one year

TIMES NEWS NETWORK

Mumbai: The city witnessed 14 life-saving transplants in the last one week thanks to four families who donated the organs of their loved ones.

As the year ends, the city is set to witness a heartening record of 79 organ donations, the highest ever since cadaver donation programme started in 1997. Over 200 organ failure patients could undergo transplants owing to the cadaver donations.

The Zonal Transplant Coordination Committee data shows that the number of donations increased by 65% in 2019 when compared with 2018 (48). T

he number of donated organs too rose by 60% as compared to the previous year. This year also witnessed more bone donations and the first pancreas transplant in the city. Overall, 121 kidneys, 68 livers, 21 hearts, 10 lungs and one pancreas were donated.

"The programme has seen unprecedented success this year, but the challenge now would be to sustain the momentum," said Dr S Mathur, president of

PUBLIC NOTICE FOR TITLE CLEARANCE REPORT

That Virenbhai Kurjibhai Bhroliya is absolute owner of below mentioned properties and he have obtained Title Clearance Report from me to obtain bank loan. Thereafter he informed that below original documents are lost. Therefore if any person, society, institution, group, trust, banks etc. Owing any right, interest, lien or claim of whatsoever nature in respect thereof are hereby informed to raise any such rights or claims within a period of 15 days from this notice along with all documentary proof, thereafter no any rights or claims shall be entertained and additional report will be issued.

Property Details:- All that piece and parcels of the immovable property of Industrial Plot No. 79, 80 totally admeasuring 265.52 sq.mtrs. in the industrial estate which is known as "Swaminarayan Industrial Estate" situated on the land bearing Revenue Survey No. 385, 386, 387, 389 paiki having it's Block No. 304 of Village :Tatithaiya, Sub District: Palsana, District : Surat.

Lost Documents:- (1) Original sale deed No. 292 dated 27.03.2002, (2) Original sale deed No. 291 dated 27.03.2002 & (3) Original sale deed No. 475 dated 30.03.1994 alongwith original registration receipts of above all sale deeds.

Rakesh A. Wadhvani (Advocate) No. 202, Dalal Ch., Vasapura, Surat. Ph. 98251-37257

PUBLIC NOTICE ENVIRONMENTAL CLEARANCE

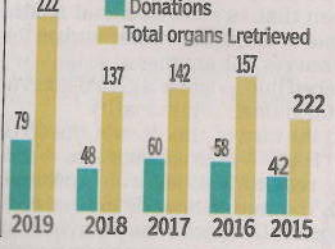
It is hereby informed that the Ministry of Environment, Forest and Climate change (IA, III Section), Indira Paryavaran Bhawan, Jor Bagh Road, New Delhi - 3, has accorded Environmental Clearance for Proposed Expansion with modification of existing Common Effluent treatment Plant of M/s. Enviro Technology Limited. (ETL) at Plot no.2413/2414 & 2211, GIDC Ankleshwar-393002 (Gujarat) vide letter No. F. No. 10-82/2018-IA-III dated 16/12/2019 under the provision of EIA Notification dated 14th September 2006, which we have received on 25/12/2019.

Copies of Clearance letter are available on website of MoEFCC/SEIAA.

Date: 30/12/2019

B D Dalwadi
(CHIEF EXECUTIVE OFFICER)

CADAVER DONATIONS IN MUMBAI



ZTCC. "Our next aim would be increase the donor pool and that could be achieved by recognizing more Non-transplant organ retrieval centres and encouraging them to identify donors," he said. TNN

VALSAD	
ESI ACT 2002	
repayment of the loans have e notices were nancial Assets but they have ublic notice.	
Date of NPA	
057.00	30/06/2018
Four (ly) as interest s etc.	
097.00	19/05/2017
Nine as on st. and	
62.00	31/12/2018
ndred 9 with dental	
38.00	16/05/2019
Nine Eight urther nses,	
ver(s) and/or payment of failing which notice under al Assets and	
icer T Branch	

BA
15
24
14
3.1
6.1
10
10
44
5.1
74
CH
11:
36
36
7:1
p.4
10:
10:
C
6.3
10:
CH
10:
3.3
10:
7:3
SUI
ATN
10d
9:11
9:21
ATN
10.4
1, 1
2:61
H
10d
11:4
3:01
6:50
DIN
6:11
SHI
1:30
ATN
10:3
CINI
1:00
3:45
EMP
6EE
RAJ
10:3
REL
CRY
TOP
11:4
12:0
1:15
CAR
GAN
RAJ
12:4
ADP
11:0
9:30
p.m.
CINE
3:30
VERI
p.m.
ERA

સેપીઓકના મૂલ્યાંકન માટે મોનીટરીંગ ટીમ આગામી મહિને આવી રહી છે. પૂર્વજ એન.સી.ટીનું ઈનલેટ-આઉટ લેટની માત્ર વધુ આવતા દોડધામ મચી છે. છેલ્લા 2 મહિના ઈન-આઉટ ડેટા પરિણામ બગાડ્યા છે. પર્યાવરણવાદી દ્વારા ઉચ્ચસ્તરીય રજૂઆત કરી છે. એનસીટીમાં નિયત માત્રા કરતા વધુ સ્વજ સંગ્રહ દુર્ગંધ ફેલાતા આજુબાજુ

કાઈનલ એફલુએન્ટ ટ્રીટમેન્ટ પ્લાન્ટ (NCT) જીપીસીબી ના માપ દંડો મુજબ કામના કરતા ચિંતામાં વધારો જાવા મળી રહ્યો છે. અંકલેશ્વર, પાનોલી અને ઝગડિયા વિસ્તારમાં આવેલા ઓદ્યોગિક એકમોના ગંદા પાણીને શુદ્ધ કરી દરિયા સુધી લઈ જવાનું કાર્ય NCT દ્વારા થાય છે. જે છેલ્લા 2 મહિના થી માપ દંડો

(આદ્યાગક વસ્ત) નિર્ધારિત માત્રા થી વધુ જમા થયેલ છે જેનાથી પીરામણ અને અંકલેશ્વર સહિત આસપાસ ના વિસ્તારોમાં દુર્ગંધ ફેલાઈ રહી છે અને હવાના આ પ્રદુષણને લીધે આસપાસ આવેલ માનવ વસાહતોની પ્રજાના સ્વસ્થા પર ગંભીર અસરો ઉભી થઈ રહી છે. સ્થાનિક પ્રકૃતિ સુરક્ષા મંડળ દ્વારા આ અંગે જીપીસીબીમાં લેખિત ફરિયાદ કરી છે. ફાઈનલ એફલુએન્ટ

બે મહિના થી જીપીસીબીએ નિર્ધારિત કરેલ માપદંડો મુજબ કાર્ય કરતું નથી જેમાં મુખ્યત્વે કેમિકલ ઓક્સીજન ડીમાંડ (COD) અને એમોનીકલ નાઈટ્રેટ (NH3-N) ટ્રીટમેન્ટ થયા પછી પણ તેના નિયત માત્રા થી વધુ NCT ના આઉટ લેટ માં નોંધવામાં આવેલ છે. અને આ પાઈપલાઈન દ્વારા કંટીયાજાળના દરિયા સુધી જાય છે.

જાતાં તસ્કરો વીલા મોઢે પરત ફર્યા રિ-હર કોમ્પ્લેક્ષના મે નિશાન બનાવ્યા

પુષ્કુંજ હરિ-હર કોમ્પ્લેક્ષના મકાન નંબર-39, 40માં હેમંતસિંહ ફરિપ્રસાદ ઠાકોરનાઓ રહે છે. પાનિવાર તેમના બંધ બે મકાનોને યાત્રી દરમિયાન તસ્કરોએ નિશાન મનાવી મકાનના દરવાજાના નકુચા ઠોડી મકાનમાં પ્રવેશ કર્યો હતો. તસ્કરોએ મકાનમાં મુકેલી તિજોરી મહીત કબાટો પોલીને સમાનને મસ્તવ્યસ્ત કરી નાખ્યો હતો. જોકે

તસ્કરોને કોઈ પણ કિંમતી ચીજ વસ્તુ હાથ નહિ લાગતા માત્ર 5 જેટલી સાડીઓ લઈને પલાયન થઈ ગયા હતા. બનાવની જાણ થતાં જ પરિવારે મકાનમાં તપાસ કરતા સાડી સિવાય કોઈ પણ વસ્તુ નહીં ગઈ હોવાથી રાહતનો શ્વાસ લીધો હતો. સી ડિવિઝન પોલીસે તસ્કરોને ઝડપી પાડવાના ચક્રોગતિમાન કર્યા છે.

ઓને સેલ્ફ ડિફેન્સની તાલીમ આપી અને મેગા ડેમોન્સ્ટ્રેશન 2000 યુવતીઓએ શક્તિનું પ્રદર્શન કર્યું



ભરૂચના હોસ્ટેલ ગ્રાઉન્ડ ખાતે સ્કૂલ, કોલેજની વિદ્યાર્થીનીઓ માટે એ.બી.વી.પી દ્વારા મિશન સાહસીનું આયોજન કરાયું હતું. • સંજય પટેલ

6 હજાર ઉપરાંતનો ઈંગ્લિશ દારૂ જપ્ત કર્યો અંકલેશ્વર GIDCમાં પાનના ગલ્લામાંથી દારૂ ઝડપાયો LCBએ ચામુંડા પાન કોર્નરમાં દારૂ ઝડપી પાડ્યો

ભાસ્કર વ્યૂઝ | અંકલેશ્વર

અંકલેશ્વર જીઆઈડીસી પાનના ગલ્લા માંથી ઈંગ્લીશ દારૂ એલ.સી. બી ઝડપી પાડ્યો હતો. 31 ડિસેમ્બર પૂર્વે પોલીસ ચેકીંગ દરમિયાન જી.આઈ. એલ.ચોકડી પર ચામુંડા પાન કોર્નરમાં દારૂ



ઝડપાયેલ સંચાલક નજરે પડે છે.

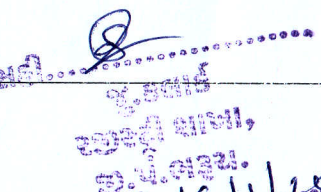
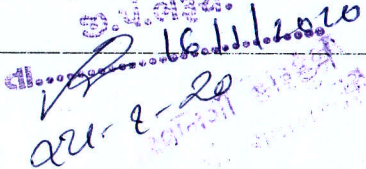

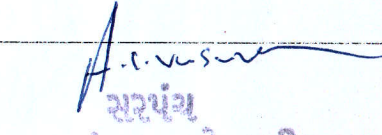




ઝડપી પાડવાની ક્વાયત હાથ ધરી હતી. દરમિયાન ભરૂચ એલસીબી પોલીસ દ્વારા ચોક્કસ માતમી આધારે જી.આઈ.એલ. ચોકડી શાકમાર્કેટ પાસે ચામુંડા પાન કોર્નર પર સર્ચ કરતા અંદર થી ઈંગ્લીશદારૂ નો જથ્થો મળી આવ્યો હતો. પોલીસે વિવિધ બ્રાન્ડની ઈંગ્લીશ દારૂ બોટલ જપ્ત કરી હતી. તેમજ પાનના ગલ્લા સંચાલક જીતેન્દ્ર ઈશ્વર ચાવડાની ધરપકડ કરી હતી.






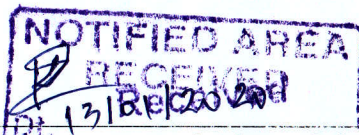

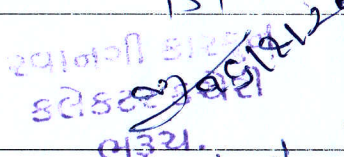

મળી આવ્યો હતો. 6 હજાર ઉપરાંતનો ઈંગ્લીશ દારૂ જપ્ત કર્યો હતો. તેમજ પાનના ગલ્લા સંચાલક ધરપકડ કરી હતી. અંકલેશ્વર પોલીસ દ્વારા 31 ડિસેમ્બરની ઉજાણીને લઈ ઈંગ્લીશ દારૂનો જથ્થો

કેનેડા-ઓસ્ટ્રેલિયા
3 વર્ષ વર્ક પર્મીટ (2 લાખ પગાર)
અમેરીકા
10 વર્ષના વિઝીટર વિઝા
૮૧૪૦૯૫૫૯૨૦

જાહેર સુચના
પર્યાવરણીય મંજૂરી
આ સાર્થે જણાવવામાં આવે છે કે, મિનિસ્ટ્ર ઓફ એન્વાયરોમેન્ટ, ફોરેસ્ટ એન્ડ ક્લાયમેટ યેન્ચ(1A, III section) ઇન્ડિયા પર્યાવરણ ભવન, નોર બાગ રોડ, નવી દિલ્હી-૩, દ્વારા એનવીરો ટેકનોલોજી લિમિટેડ, પ્લોટ નં.૨૨૧૩/૨૪૧૪ & ૨૨૧૧, જી.આઈ.ડી.સી. ઇન્ડસ્ટ્રીયલ ઈસ્ટેટ, અંકલેશ્વર-૩૯૩૦૦૨ (ગુજરાત) ખાતે હાલનાં કોમનએફલુએન્ટ ટ્રીટમેન્ટ પ્લાન્ટ માં ફેરફાર સાથે સુચીત વધારો કરવા માટેની પર્યાવરણીય મંજૂરી ક્રમાંક નં. F. NO. 10-82/2018-IA-III તારીખ 19-12-2018 દ્વારા ઈ.આઈ.એ.નોટીફિકેશન તારીખ ૧૪ સપ્ટેમ્બર ૨૦૦૬ નોગવાઈ ફેરફાર આપેલ છે, જે અમને તારીખ ૨૬-૧૨-૨૦૧૯ ના રોજ મળેલ છે. ક્લીયરન્સ ધરાવતી નકલ મિનિસ્ટ્ર ઓફ એન્વાયરોમેન્ટ, ફોરેસ્ટ એન્ડ ક્લાયમેટ યેન્ચ ની વેબસાઈટ ઉપર ઉપલબ્ધ છે.
બી.ડી.દલપાડી
(ચીફ એક્ઝીક્યુટીવ ઓફીસર)
તા.૩૦-૧૨-૨૦૧૯

**Environment Clearance for proposed expansion with modification of CETP – ETL
Ankleshwar**

Sr. No.	Address	Sign
1	Jilla Panchayat office, Bharuch	
2	Taluka Panchayat Office Ankleshwar	
3	Taluka Panchayat Office Jhagadia	
4	The Sarpanch Gram Panchayat – Dadhal	
5	The Sarpanch Gram Panchayat – Kosambdi	
6	The Sarpanch Gram Panchayat – Kapodara	
7	The Sarpanch Gram Panchayat – Bhadkodara	
8	The Sarpanch Gram Panchayat – Andada	
9	The Sarpanch Gram Panchayat – Jitali	
10	The Sarpanch Gram Panchayat – Gadkhoi	

11	The Sarpanch Gram Panchayat – Piraman, Piraman, Ankleshwar	 15-1-2020 પીરામણ ગ્રામ પંચાયત તા. અંકલેશ્વર, જિ. ભરૂચ
12	The Sarpanch Gram Panchayat – Sarangpur	 સારંગપુર ગ્રામ પંચાયત તા. અંકલેશ્વર, જિ. ભરૂચ
13	Mr. Yogesh P. Panua Safety Health and Environment Association	 Bharuch
14	Mr. Jayesh Patel Centre For Environment Science and Community,	
15	Manish Rana Paryavaran Mitra	
16	Ankleshwar Nagar Palika,	 15-1-2020 અંકલેશ્વર નગર પેલા સદન
17	Notified Area Office, Ankieshwar	
18	Notified Area Office, Panoli	Date:- 15/1/2020 Notified Area Office GIDC, Panoli.
19	Notified Area Office, Jhagadia	 15/1/20
20	Collector District Collector office, Bharuch	 15/1/20
21	The principle, Footwear Design & Development Institute	
22	The Principle, Pioneer School, Jitali	I/C Belim MS. આચાર્ય શ્રી



પાયોનિઅર માધ્યમિક અને
ઉચ્ચતર માધ્યમિક શાળા
જિતાલી તા. અંકલેશ્વર જિ. ભરૂચ

23	The Principle, P. S School, Jitali	<i>E/C</i> <i>12/11/20</i> <i>Principal</i>
24	The Principle Shree Gattu Vidyalaya, Ankleshwar	<i>P</i> PRINCIPAL SHREE GATTU VIDYALAYA ANKLESHWAR
25	The Principle, Smt Puspavati Devidas Shroff Sanskardeep Vidhyalaya Ankleshwar	<i>P</i> SHROFF SMT. PUSPAVATI DEVIDAS 2019 ANKLESHWAR
26	The Principle Lions International Academy, Ankleshwar	<i>Devi</i> 13/11/2020 98530950076
27	The Principle Lion School Ankleshwar	<i>R. D. Jayar</i>
28	The Principle, Chandrabala Modi, academy, Ankleshwar	<i>g.m</i> 15/11/2020 PRINCIPAL CHANDERBALA MODI ACADEMY P.O. KONDR, VALIA ROAD, ANKLESHWAR - 390 001 DIST. BHARUCH (GUJARAT)
29	The Principle, R.B.L.P.S School, Ankleshwar	
30	Dr. A. K. Patel Ankleshwar	<i>Shrikant K. K</i> 02646-246535
31	Dr. Mahesh Mistry Ankleshwar	<i>[Signature]</i>
32	Administration office, ESIC Hospital	<i>Soni</i> 15/11/2020
33	Smt. Jayaben Modi Hospital	<i>Soni</i> 13/11/20

o/c copy



ENVIRO TECHNOLOGY LIMITED

Ref: ETL/ANK/06/2023/277

GPCB ID: 15074

Date: 28th June, 2023

To,
The Member Secretary
Gujarat Pollution Control Board
Paryavaran Bhavan
Sector – 10 / A,
Gandhinagar

Sub: Environmental Statement for the year 2022-23

Dear Sir,

We are forwarding herewith Environmental Statement (Form V) for our Common Effluent Treatment Plant situated at Plot No.2413 / 2414 & 2211 G.I.D.C., Ankleshwar – 393 002, Dist. Bharuch, for the year 2022-2023. The treated effluent is being sent to FETP of NCT for further treatment and disposal.

Thanking you.

Yours faithfully,

For, Enviro Technology Ltd

A.M. Darji
(Unit Head)

CC: The Regional Officer, GPCB, Ankleshwar

30/06/23
Gujarat Pollution Control Board
Head Office
Sector No.-10-A,
Gandhinagar-382010

RECEIVED
G. P. C. Board
R. O. Ankleshwar
Date. 28/6/2023

CIN NO. :

U72200GJ1994PLC023786

Works Office :

2413/2414 & 2211, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)

Phone : (02646) 223569, 252768, 250707

Email : dalwadibd@beil.co.in, darjiam@beil.co.in

Office :

9701-16, GIDC Estate, Ankleshwar - 393 002 Dist. : Bharuch (Gujarat)

ENVIRONMENTAL STATEMENT

PART - A


01	Name and address of the owner / occupier of the industry / operation or process		Director – Mr. Ashok Panjwani Unit Head – Mr. A.M. Darji
			Enviro Technology Ltd. 2413 – 2414, & 2211 GIDC Estate Ankleshwar – 393 002
02	Industry Category	Primary – STC Code	
		Secondary–SIC Code	
03	Production capacity	Units	Not applicable, it is a Common Effluent Treatment Plant
04	Year of establishment		1997
05	Date of the last Environmental Statement submitted		4 th May,2022

PART - B

Water and Raw material Consumption

01	Water Consumption	≈ 74.13 m ³ / day	
	Process	38.70 m ³ / Day	Water is consumed for Di sodium Hydrogen phosphate & Magnesium chloride solution preparation, Primary & Tertiary Sand Filter & Activated Carbon Filter Backwash, Bioaugmentation and domestic purpose.
	Cooling	15.30 m ³ / Day	
	Domestic	20.12 m ³ / day	

Sr. No.	Name of Products (*)	Process Water Consumption per unit of product output	
		During the previous financial year	During the current financial year
1.	There is no manufacturing activity as this is a Common Effluent Treatment Plant. Our design capacity is to treat 2200 m ³ / day of Industrial effluent.		
(*)	Industry may use codes if disclosing details of raw material would violate contractual obligations, otherwise all industries must name the raw material used.		





02: Raw Material Consumption

Sr. No.	Name of Products (*)	Consumption of raw material (In Kgs)	
		During the current financial year 2021 -2022	During the current financial year 2022 -2023
1.	Hy. Lime	431433.5	542619.6
2.	Hydrogen Peroxide	483	667
3.	Ferrous Sulphate (Solid)	5440	2370
4.	Deforming Agent	1910	2440
5.	Polyelectrolyte (Type - 2)	4018.57	3220.5
6.	Phosphoric Acid	141610.5	28775.28
7.	Magnesium Salt	166275	45626
8.	Sodium Salt	46500	13300
9.	Sodium Tri-poly Phosphate (STPP)	1847	2080
10.	Poly Aluminum Chloride (PAC)	5840	4045
11.	Deformer (Silicon Base Fin-18)	47620	39450
12.	C.S. Lye (30%)	210458.6	53512.78

PART - C

Pollution discharged to environment / unit of output.
(Parameters as specified in the Consent issued)

Sr, No.	Pollutants	Quantity of pollutants discharged. (mass / day)		Concentrations of pollutants in discharges (mass / volume)	Percentage of variation from prescribed Standards with reasons
a	Water	COD	2102 Kg/ day	886 mg/l	-11.4%
		BOD	47.62 Kg/day	20 mg/l	-90%
		Ammonical Nitrogen	159.5 Kg/day	47 mg/l	-6%
b	Air	All parameters specified in consent for D.G.set stack & ambient air are within limit.			




PART – D
HAZARDOUS WASTE

(as specified under Hazardous Wastes [Management Handling & Trans – boundary Movement] Rules, 2008)


Hazardous Wastes		Total Quantity	
		During the previous financial year-21-22	During the current financial year-22-23
Category	Hazardous waste		
A) From Process			
35.3	Chemical Sludge from wastewater treatment	8519.300 MT	4578.945 MT
33.1	Discarded Containers	503 Nos.	270 Nos.
5.1	Used Oil	1645 Liters	197 Liters
B) From Pollution Control Facilities			
Nil			

PART – E
SOLID WASTE

Hazardous Wastes		Total Quantity in M ³ /MT	
		During the current financial year 2021-2022	During the current financial year 2022-2023
a	From Process	NIL	NIL
b	From pollution control facilities (generation)	NIL	NIL

PART – F

- Please specify the characteristics (in terms of composition and quantum) of hazardous as well as solid wastes and indicate disposal practices adopted for both these categories of wastes.
- The major source of solid waste generation in the CETP is from primary treatment & MAP treatment of effluent from the member industries. The sludge generated is dewatered with the help of a super decanter.
- ETP sludge is disposed to the Centralized Secured Landfill Facility at BEIL-Ankleshwar.





PART – G

- Impact of the pollution abatement measures taken on conservation of natural resources and on the cost of production.
- CETP was started to sort out the environmental problems faced by industries especially small-scale industries in this region. With commissioning and operation of the CETP, the waste disposal problem of member industries has been solved.
- As suggested by NEERI, we are adding Sewage to secondary treatment which helps better reduction of organics.
- The treated effluent is sent to FETP of NCT for further treatment and disposal up to deep sea through closed pipeline system. ETL is making payment of approximately Rs.66 Lacs per month to NCT for further treatment and disposal of the treated effluent.
- Under the guidance of IIT Mumbai & Kanpur improved the performance of the CETP including bio-augmentation by implementing new ASP + MLE system.
- With the segregation and treatment of effluent for removal of Ammonical Nitrogen with physico chemical treatment, the Ammonical Nitrogen at the CETP outlet is maintained 25 to 45 mg/l consistently.
- Implemented ASP + MLE system in biological process.

PART – H

- Addition measures / investment proposal for environmental protection including abatement of pollution, prevention of pollution.
- The sludge generated will be disposed of at the secured landfill of BEIL and Monthly expenditure will be approx. Rs. 11 Lacs.
- Engaged IIT (Kanpur + Mumbai) for further studies to reduce refractory COD & Improve CETP performance. Approximately Rs 35 Lacs is spent on the studies.
- We have Installed TOC/TN Meter at a cost of Rs 35 Lacs in November- 2012 & Connected to GPCB XGN.
- ETL has sponsored a project on "Electro Chemical Oxidation "studies with Engg. College, SRICT. Annual expenditure Rs. 6 lacks.
- We are displaying COD/BOD/pH/TSS & Flow on vendor's server by which real time monitoring by GPCB/CPCB.




PART – I

Any other particulars for improving the quality of the environment.

- 1 Display of information with respect to operation, at the front of the Company, for the public
- 2 Students / Community are permitted to visit the CETP. Required guidance are given to the students who are doing Environmental Courses
- 3 Tree plantation is taken up as an important activity.
- 4 ETL has integrated system for ISO 14001:2015 & ISO 45001:2018.
- 5 ETL Laboratory has got NABL accreditation as per ISO 17025:2005.
- 6 Microbiological laboratory is set up and is in operation.
- 7 Treatability studies are conducted, and it is an on-going activity.
- 8 8.1 % reduction in sludge generation compared to previous year by process modification & optimization.
- 9 GPS System installed on tankers and helps in tracking.
- 10 Manifest system for transporting effluent from member industry to ETL.
- 11 Studies are conducted through IIT Kanpur / Mumbai for improving performance.
- 12 Electrochemical oxidation studies are carried out through SRICT Ankleshwar

For, Enviro Technology Limited


A. M. Darji
Unit Head



Date: 28.06.2023

Place :- Ankleshwar

ENVIRO TECHNOLOGY LTD., ANKLESHWAR

EFFLUENT RECEIPT DATA APRIL-2022 TO MARCH-2023

Month	Total No. of Tankers Received	Average COD ppm	Average Acidity ppm	Average NH4-N ppm
April 2022	4314	4006	990	109
May 2022	4457	3921	1004	106
June 2022	4482	3913	1195	138
July 2022	4749	3713	815	94
August 2022	4600	3760	918	95
September 2022	4577	3714	921	93
October 2022	4005	3848	979	90
November 2022	4013	4194	1026	98
December 2022	4317	4079	766	86
January 2023	4125	4319	903	87
February 2023	4120	4250	964	76
March 2023	4273	4067	944	77

HAZARDOUS WASTE DETAILS (CETP SLUDGE) ALL QTY. IN KGS

Month	Opening Balance	Generation	Dispatched to BEIL for Landfilling	Closing Balance
April 2022	00	474260	474260	00
May 2022	00	372290	372290	00
June 2022	00	337470	337470	00
July 2022	00	333270	333270	00
August 2022	00	289080	289080	00
September 2022	00	289410	289410	00
October 2022	00	333660	333660	00
November 2022	00	732045	732045	00
December 2022	00	476120	476120	00
January 2023	00	382030	382030	00
February 2023	00	288780	288780	00
March 2023	00	270530	270530	00
Total		4578945	4578945	



Date of Sampling: 05th January 2023

Sr. No.	Parameters	Unit	Result	Method Ref.
ETP SLUDGE ANALYSIS				
1	CaSO ₄	%	5.19	IS-4256
2	CaCO ₃	%	72.53	IS 2720: Part 23
3	LOD at 105 °C	%	48.61	APHA 2540 B
4	Total Inorganic Solids	%	97.04	APHA 2540-G
ETP SLUDGE 10 % LEACHATE ANALYSIS				
5	Total Acidity	mg/L	NIL	APHA 2310-B
6	Total Alkalinity	mg/L	749	APHA 2320-B
7	COD	mg/L	598	APHA 5220-B
8	Oil % Oil emulsion	mg/L	2.84	APHA 5520 - B
9	Cyanide	mg/L	BDL	APHA 4500-CN -G
10	Fluoride	mg/L	0.819	APHA 4500-F -D
11	Phenolic Compound	mg/L	BDL	APHA 5530 - D
12	Iron	mg/L	1.7384	APHA 3111-Fe- B
13	Total Chromium	mg/L	0.3519	APHA 3111-Cr-B
14	Manganese	mg/L	0.1686	APHA 3111-Mn- B
15	Zinc	mg/L	0.1924	APHA 3111-Zn- B
16	Copper	mg/L	0.0428	APHA 3111-Cu-B
17	Lead	mg/L	0.1439	APHA 3111-Pb-B
18	Nickel	mg/L	0.3978	APHA 3111-Ni- B

SOIL ANALYSIS REPORT

Sr.No.	Parameters	Results of sampling Done on 21.08.21	Results of sampling Done on 15.02.22
1	pH	7.69	7.58
2	TDS	341 ppm	497 ppm
3	Chloride	62 ppm	106 ppm
4	COD	12 ppm	26 ppm
5	BOD	BDL	BDL
BDL = Below Detectable Limit			



AMBIENT AIR MONITORING DATA APRIL 2022 TO MARCH 2023







Sr.No.	Month	PM10	PM2.5	SO2	NOx
		µg / Nm ³			
1	April 2022	78.68	27.15	24.16	40.01
2	May 2022	77.42	24.85	20.70	34.69
3	June 2022	67.09	21.51	20.32	32.15
4	July 2022	55.02	18.53	18.73	26.97
5	August 2022	56.81	19.33	20.62	31.56
6	September 2022	64.15	23.15	22.63	31.31
7	October 2022	61.58	21.98	22.35	30.54
8	November 2022	64.29	23.21	23.26	33.02
9	December 2022	65.66	24.98	25.75	35.68
10	January 2023	67.52	25.90	26.41	37.09
11	February 2023	71.37	26.06	26.82	36.04
12	March 2023	71.24	25.66	25.86	35.41







D.G STACK MONITORING APRIL 2022 TO MARCH 2023

Sr.No.	Month	SPM milligram/NM3	SO2 ppm	NOx ppm
1	April 2022	31.84	9.57	19.32
2	May 2022	30.15	10.08	18.46
3	June 2022	28.42	8.09	16.87
4	July 2022	26.80	7.96	15.20
5	August 2022	37.59	8.07	14.21
6	September 2022	27.21	10.45	19.66
7	October 2022	25.63	11.85	20.43
8	November 2022	28.63	12.07	21.81
9	December 2022	24.56	10.94	19.43
10	January 2023	26.74	11.63	18.47
11	February 2023	28.52	12.45	19.17
12	March 2023	26.59	11.53	17.41



Environment Clearance of Expansion of CETP – ETL Ankleshwar

Sr. No.	Address	Sign
1	Taluka Panchayat Office Anklwshwar	
2	The Sarpanch Gram Panchayat – Kosamdi	 તલાટી કમ મંત્રી કોસમડી, તા. અંકલેશ્વર.
3	The Sarpanch Gram Panchayat – Kapodara	તલાટી કમ મંત્રી ગ્રામ પંચાયત અંદાડા તા. અંકલેશ્વર, જિ. ભરૂચ
4	The Sarpanch Gram Panchayat – Bhadkodara	 તલાટી કમ મંત્રી ગ્રામ પંચાયત, ભાદકોદરા તા. અંકલેશ્વર, જિ. ભરૂચ
5	The Sarpanch Gram Panchayat – Andada	 તલાટી કમ મંત્રી ગ્રામ પંચાયત અંદાડા તા. અંકલેશ્વર, જિ. ભરૂચ
6	The Sarpanch Gram Panchayat – Jitali	તા. અંકલેશ્વર, જિ. ભરૂચ  ગ્રા. પં. જિતાલી, તા. અંકલેશ્વર
7	The Sarpanch Gram Panchayat – Sarangpur	 સરપંચ સારંગપુર ગામ પંચાયત

Sr. No.	Address	Sign
8	The Principal Shree Gattu Vidyalaya, Ankleshwar	 
9	The Principal Lions International Academy, Ankleshwar	 
10	The Principal Lion School Ankleshwar	 
11	Smt. Jayaben Modi Hospital	